





## MECHANICAL SPECIFICATIONS – GENERAL

1. GENERAL
- 1.1 GENERAL REQUIREMENTS
- A. READ AND CONFORM TO:
- 1 THE CONTRACT CCDC 2, STIPULATED PRICE CONTRACT AS AMENDED.
  - 2 DIVISION 1 REQUIREMENTS AND DOCUMENTS REFERRED TO THEREIN.
- B. THE SPECIFICATIONS ARE INTEGRAL WITH THE DRAWINGS WHICH ACCOMPANY THEM. NEITHER IS TO BE USED ALONE. ANY ITEM OR SUBJECT OMITTED FROM ONE BUT IMPLIED IN THE OTHER IS FULLY AND PROPERLY REQUIRED.
- C. WHEREVER DIFFERENCES OCCUR IN THE TENDER DOCUMENTS, THE MOST ONEROUS CONDITION GOVERNS. BASE THE BID ON THE COSTLIEST ARRANGEMENT.
- D. ENSURE SUB-CONTRACTORS UNDERTAKING THE WORK PROVIDE A 50% PERFORMANCE BOND AND A 50% LABOUR AND MATERIALS PAYMENT BOND. IN ADDITION, ENSURE SUB-CONTRACTORS EMPLOYED TO UNDERTAKE ANY PART OF THE WORK THAT IS \$50,000.00 OR GREATER IN CONTRACT VALUE PROVIDE A 50% PERFORMANCE BOND AND A 50% LABOUR AND MATERIALS BOND TO THE PARTY THEY ARE IN CONTRACT WITH.
- E. CONFORM TO THE LATEST EDITION OF ONTARIO BUILDING CODE (CSA STANDARDS), ONTARIO FIRE CODE, LOCAL & DISTRICT BYLAWS, REGULATIONS, & PUBLISHED ENGINEERING STANDARDS.
- F. NOTIFY CONSULTANT UPON DISCOVERY OF CONDITIONS WHICH ADVERSELY AFFECT WORK OF THIS DIVISION. NO ALLOWANCE WILL BE MADE AFTER LETTING OF CONTRACT FOR ANY EXPENSES INCURRED THROUGH FAILURE TO DO SO.
- G. ARRANGE AND PAY FOR PERMITS AND INSPECTIONS BY AUTHORITIES HAVING JURISDICTION, REQUIRED IN THE UNDERTAKING OF THIS DIVISION. MAKE MODIFICATIONS REQUIRED BY AUTHORITIES.
- H. ALL TRADESMEN EMPLOYED ON THE PROJECT SHALL HOLD VALID TRADE CERTIFICATES/ LICENSES AND SHALL MAKE A COPY AVAILABLE FOR REVIEW BY THE CONSULTANT AND/OR OWNER WHEN REQUESTED.
- 1.2 SCOPE OF WORK
- A. PRODUCTS AND METHODS MENTIONED OR SHOWN IN THE CONTRACT DOCUMENTS COMPLETE WITH INCIDENTALS NECESSARY FOR A COMPLETE OPERATING INSTALLATION. PROVIDE ALL TOOLS, EQUIPMENT AND SERVICES REQUIRED TO DO THE WORK.
- B. SITE EXAMINE EXISTING CONDITIONS WHICH MAY AFFECT WORK OF THIS DIVISION. EXAMINE ALL CONTRACT DOCUMENTS IN CONJUNCTION WITH SITE EXAMINATION TO ENSURE THAT WORK OF THIS DIVISION MAY BE SATISFACTORILY COMPLETED.
- C. DISCONNECTION AND REMOVAL OF VARIOUS MECHANICAL EQUIPMENT IN AREAS TO BE TURNED OVER TO THE OWNER.
- D. DISCONNECTION AND MAKING SAFE OF VARIOUS MECHANICAL SYSTEMS AND EQUIPMENT IN AREAS TO BE DEMOLISHED AND/OR RENOVATED.
- E. ISOLATE AND DRAIN (OR PIPE FREEZE IF DRAINING IS NOT FEASIBLE) SYSTEMS AS REQUIRED TO EFFECT DEMOLITION, RENOVATIONS, MODIFICATIONS AND/OR REPAIRS. DISCONNECT, CAP AND MAKE SAFE ALL MECHANICAL SERVICES TO THE BUILDING INCLUDING, BUT NOT LIMITED TO, SANITARY SEWERS(S), STORE (SEWER(S)), WATER SERVICE, NATURAL GAS SERVICE AND HOT WATER HEATING SYSTEMS.
- F. ON COMPLETION OF RENOVATIONS, MODIFICATIONS AND/OR REPAIRS, TEST ENTIRE SYSTEM AS NEW. REPORT REPAIRS OR REPLACEMENTS REQUIRED OF EXISTING EQUIPMENT, PIPING, FITTINGS OR DEVICES THAT ARE NOT INCLUDED IN CONTRACT TO CONSULTANT AND OWNER FOR INSTRUCTION. FLUSH, CLEAN AND REFILL RENOVATED SYSTEMS AS SPECIFIED FOR NEW.
- G. BE RESPONSIBLE FOR THE EXCAVATION & BACKFILL NECESSARY FOR INSTALLATION OF UNDERGROUND WORK. EXCAVATE WITH SUITABLE MACHINERY OR BY HAND AS NECESSARY.
- H. CUTTING AND PATCHING OF NEW OR EXISTING WORK.
- I. IDENTIFICATION OF EQUIPMENT, PIPING, VALVES AND CONTROLLERS.
- J. PERFORM START-UP AND COMPLETELY COMMISSION ALL EQUIPMENT AND SYSTEMS INSTALLED AND/OR MODIFIED UNDER THIS CONTRACT. COMMISSIONING WORK SHALL BE COMPLETED TO THE SATISFACTION OF THE CONSULTANT PRIOR TO ACCEPTANCE OF THE WORK OR ANY PART THEREOF.
- K. APPLY FOR & OBTAIN ALL PERMITS INCLUDING BUILDING PERMITS, & TSSA APPLICATIONS, LICENSES, OR CERTIFICATES NECESSARY FOR THE PERFORMANCE OF THE WORK. COORDINATE ALL WORK WITH BUILDING OFFICIALS & AUTHORITIES HAVING JURISDICTION.
- L. TAKE SUCH MEASURES AND INCLUDE IN BID PRICE FOR THE PROPER PROTECTION OF THE EXISTING BUILDING AND ITS FINISHES AT ALL TIMES DURING ALTERATIONS AND CONSTRUCTION OF THE NEW ADDITION. COORDINATE THIS PROTECTIVE WORK WITH ALL TRADES.
- M. VERIFY THE CORRECT OPERATION OF EACH EQUIPMENT ITEM PROVIDED AND/OR ALTERED AND EACH SYSTEM IN TOTAL AND OBTAIN THE OWNER'S APPROVAL PRIOR TO STARTING AND/OR RETURNING TO OPERATION.
- N. ARRANGE FOR AND PROVIDE OWNERS TRAINING ON ALL NEW EQUIPMENT.
- 1.3 SUBMITTALS
- A. SHOP DRAWINGS: PREPARE AND SUBMIT TWO (2) COPIES OF SHOP DRAWINGS OF ALL EQUIPMENT ITEMS TO THE CONSULTANT FOR REVIEW. THE CONSULTANT WILL RETURN ONE COPY, MARKED WITH COMMENTS AND HIS REVIEW STAMP AS HE DEEMS APPROPRIATE.
- 1 CLEARLY INDICATE MANUFACTURER'S AND SUPPLIER'S NAMES, MODEL NUMBERS, DETAILS OF CONSTRUCTION, ACCURATE DIMENSIONS, CAPACITIES AND PERFORMANCE. PRIOR TO SUBMISSION CHECK AND CERTIFY AS CORRECT, SHOP DRAWINGS AND DATA SHEETS. DO NOT ORDER EQUIPMENT UNTIL A COPY OF THE SHOP DRAWINGS, REVIEWED BY CONSULTANT, HAS BEEN RETURNED TO CONTRACTOR.
  - 2 THE CONSULTANT WILL NOT REVIEW SHOP DRAWINGS THAT FAIL TO BEAR THE CONTRACTOR'S STAMP OF APPROVAL OR CERTIFICATION.
- B. AS-BUILT RECORDS: BEFORE FINAL PAYMENT, SUBMIT TWO SETS OF AS-BUILTS DRAWINGS IN AUTOCAD FORMAT SHOWING ALL CHANGES & CONCEALED SERVICES DIMENSIONED.
- C. REQUESTS FOR SHUT-DOWN: OBTAIN PERMISSION FOR SYSTEMS SHUT-DOWN AND/OR SERVICE INTERRUPTION FROM THE OWNER PRIOR TO DISRUPTION OF ANY SYSTEM OR SERVICE IN USE BY THE OWNER. EMPLOY THE OWNER'S STANDARD FORM OF REQUEST WHERE AVAILABLE.
- D. REQUESTS FOR START-UP: OBTAIN PERMISSION FROM THE OWNER TO START-UP OR TO RETURN TO SERVICE ANY ITEM OF EQUIPMENT, SYSTEM OR SERVICE INSTALLED NEW OR PREVIOUSLY SHUT-DOWN.
- E. WARRANTY: PROVIDE WRITTEN GUARANTEE FOR ALL NEW EQUIPMENT & WORKMANSHIP FOR ONE (1) YEAR FROM DATE OF SUBSTANTIAL COMPLETION. FIVE (5) YEARS FOR COMPRESSOR & HEAT EXCHANGER. DEFECTIVE PARTS REPAIRED OR REPLACED WITHOUT CHARGE.
- 2 COMMON WORK RESULTS
- 2.1 PIPING SPECIALTIES
- A. CAST BRASS, PRESSURE, COPPER TO COPPER UNIONS SHALL BE USED WITH SEAMLESS COPPER TUBING SMALLER THAN 3" (75 MM).
- B. DART TYPE, 125 LB. (60 KPA) BLACK MALLEABLE IRON UNIONS SHALL BE USED WITH ALL STEEL PIPE FOR PIPING 2-1/2" (65 MM) AND SMALLER.
- C. PIPING SPECIALTIES INCLUDING BACKFLOW PREVENTERS, STRAINERS, VALVES ETC. SHALL BE LINE SIZE UNLESS INDICATED OTHERWISE ON DRAWINGS.
- D. STRAINERS
- 1 APPROVED MANUFACTURERS: SARCO SB, S.A. ARMSTRONG, CRANE, CONBRACO, COLTON
  - 2 IN COPPER TUBING: CLASS 250, WYE TYPE, BRONZE, SCREWED CONNECTION, WITH BLIND CAPS, AND 1/32" (0.8 MM) PERFORATED STAINLESS STEEL SCREEN.
  - 3 IN STEEL PIPING: 2" (50MM) AND SMALLER
    - 1 BODY AND COVER: SCREWED, LINE SIZE Y TYPE STRAINER, SEMI-STEEL CONFORMING TO ASTM A278-85, CLASS 30, COMPLETE WITH SCREWED BLIND CAP. PRIMARY SERVICE RATING OF 125 PSI @ 350 F (860 KPA @ 178 C). BODY SHALL HAVE SIDE DRAIN CONNECTION.
    - 2 SCREEN: PERFORATED TYPE 304 STAINLESS STEEL SERVICE
      - 1 WATER 1/32" (0.8 MM)
- 2.2 FIRE STOPPING COMPOUNDS
- A. APPROVED MANUFACTURER: 3M PRODUCTS INDICATED.
- B. OTHER ACCEPTABLE MANUFACTURERS OFFERING EQUIVALENT PRODUCTS: DOW CORNING, JOHN MANVILLE, HILTI FIRESTOP SYSTEMS
- C. FIRE RATED SEALANTS: INTUMESCENT MATERIAL, SYNTHETIC ELASOMERS, CAPABLE OF EXPANDING UP TO 8 TO 10 TIMES WHEN EXPOSED TO TEMPERATURES OF 250°F (121°C) OR HIGHER. ULC LISTED AND LABELLED.
- 2.3 NAMEPLATES
- A. PROVIDE LAMINATED PLASTIC PLATES WITH BLACK FACE AND WHITE CENTRE OF MINIMUM SIZE 3-1/2" X 1-1/2" X 3/32" (90 X 40 X 2 MM) NOMINAL THICKNESS, ENGRAVED WITH 1/4" (6 MM) HIGH LETTERING. USE 1" (25 MM) LETTERING FOR MAJOR EQUIPMENT.

## MECHANICAL SPECIFICATIONS – GENERAL

- B. FASTEN NAMEPLATES SECURELY IN CONSPICUOUS PLACE. WHERE NAMEPLATES CANNOT BE MOUNTED ON COOL SURFACE, PROVIDE STANDOFFS.
- C. IDENTIFY EQUIPMENT TYPE AND NUMBER AND SERVICE OF AREAS OR ZONE OF BUILDING SERVED.
- D. FOR EACH ITEM OF EQUIPMENT WHICH MAY BE STARTED AUTOMATICALLY OR REMOTELY, ADD A RED LAMACOID PLATE, 2-1/2" X 9" (65 X 230 MM), READING: "WARNING. THIS EQUIPMENT IS AUTOMATICALLY CONTROLLED AND MAY START AT ANY TIME."
- 2.4 PRESSURE GAUGES
- A. APPROVED MANUFACTURER: TRERRICE MODEL 600C.
- B. OTHER ACCEPTABLE MANUFACTURERS OFFERING EQUIVALENT PRODUCTS: WEISS, WINTER, MORRISON, TAYLOR.
- C. GAUGES: 4-1/2" (115MM) DIAMETER BLACK CAST ALUMINUM, PHOSPHOR BRONZE BOURDON TUBE, ROTARY BRASS MOVEMENT, BRASS SOCKET, WITH FRONT RECALIBRATION ADJUSTMENT, BLACK SCALE ON WHITE BACKGROUND, MID-SCALE ACCURACY: 1%, SCALE: PSI AND KPA
- D. GAUGE COOK: TEE OR LEVER HANDLE, BRASS FOR MAXIMUM 150 PSI (1034 KPA).
- E. NEEDLE VALVE: BRASS, 1/4" (6 MM) NPT FOR MINIMUM 150 PSI (1034 KPA).
- F. PULSATION DAMPER: PRESSURE SNUBBER, BRASS WITH 1/4" (6 MM) CONNECTIONS.
- G. SYPHON: STEEL, SCHEDULE 40, 1/4" (6 MM) ANGLE OR STRAIGHT PATTERN.
- 2.5 STEM TYPE THERMOMETERS
- A. APPROVED MANUFACTURER: TRERRICE MODEL BX91403-1/2.
- B. OTHER ACCEPTABLE MANUFACTURERS OFFERING EQUIVALENT PRODUCTS: WEISS MODEL 9V53-1/2, WINTER, MORRISON, TAYLOR.
- C. THERMOMETER: 9" (230MM) SCALE, RED APPEARING THERMAL FLUID WITH BLACK FIGURES ON WHITE SCALE, CALIBRATED IN BOTH DEGREES F AND DEGREES C, ACCURACY TO ASTM E77 OF 2%, CLEAR GLASS LENS FRONT TUBE, CAST ALUMINUM CASE WITH ENAMEL FINISH, CAST ALUMINUM ADJUSTABLE JOINT WITH POSITIVE LOCKING DEVICE, 3/4" (20MM) NPT BRASS STEM.
- D. ALL THERMOMETERS TO INCLUDE A SEPARABLE WELL.
- E. SOCKET: BRASS SEPARABLE SOCKETS FOR THERMOMETER STEMS WITH OR WITHOUT EXTENSIONS AS REQUIRED, AND WITH CAP AND CHAIN
- F. FLANGE: 3" (75 MM) OUTSIDE DIAMETER REVERSIBLE FLANGE, DESIGNED TO FASTEN TO SHEET METAL AIR DUCTS, WITH BRASS PERFORATED STEM
- 2.6 SLEEVES
- A. MATERIALS: MINIMUM SCHEDULE 20 GALVANIZED STEEL OR CAST IRON.
- 2.7 FLASHINGS AND COUNTER FLASHINGS
- A. THALER OR EQUIVALENT MECHANICAL/ELECTRICAL FLASHINGS AS RECOMMENDED FOR SPECIFIC PURPOSE.
- B. STAINLESS STEEL FLASHING SLEEVE, INTEGRAL DECK FLANGE AND EPDM SEAL.
- 2.8 PENETRATION SEALS
- A. APPROVED MANUFACTURER: LINK-SEA OR EQUAL.
- B. MODULAR MECHANICAL TYPE, CONSISTING OF INTERLOCKING SYNTHETIC RUBBER LINKS SHAPED TO CONTINUOUSLY FILL THE ANNULAR SPACE BETWEEN THE PIPE AND WALL OPENING. LINKS SHALL BE LOOSELY ASSEMBLED WITH BOLTS TO FORM A CONTINUOUS RUBBER BELT AROUND THE PIPE WITH A PRESSURE PLATE UNDER EACH BOLT HEAD AND NUT.
- 2.9 ACCESS DOORS
- A. STANDARD UNIVERSAL FLUSH
- 1 MATERIAL: UPT TO 16" X 16" (400X400) 16 GAUGE MOUNTING FRAME, OVER 16" X 16" (400X400) 14 GAUGE DOOR, 16 GAUGE MOUNTING FRAME.
  - 2 HINGE: CONTINUOUS, CONCEALED.
  - 3 LATCH: STAINLESS STEEL SCREWDRIVER OPERATED CAM LATCH
  - 4 FINISH: STEEL: 5-STAGE IRON PHOSPHATE PREPARATION WITH PRIME COAT OF WHITE, ALKYD BAKING ENAMEL OR STAINLESS STEEL TYPE 304, NO. 4 SATIN POLISH.
- B. MANUFACTURERS: ACUDOR ACONR, CEB, MIFAB, CENDRES CONTOUR
- C. RECESSED ACCESS DOOR
- 1 MATERIAL: STEEL OR STAINLESS STEEL, 22 GAUGE DOOR, 22 GAUGE MOUNTING FRAME. DOOR - RECESSED 5/8"
  - 2 HINGE: CONTINUOUS, CONCEALED.
  - 3 LATCH: STAINLESS STEEL SCREWDRIVER OPERATED CAM LATCH
  - 4 FINISH: SATIN COAT STEEL
- D. MANUFACTURERS: ACUDOR ACONR, CEB, MIFAB, CENDRES CONTOUR
- C. FIRE RATED
- 1 ACCESS DOORS IN FIRE SEPARATIONS OR FIRE RATED ASSEMBLIES: ULC LABELLED. REFER TO ARCHITECTURAL DRAWINGS FOR RATINGS OF FIRE SEPARATIONS AND ASSEMBLIES. MINIMUM 12 GAUGE.
  - 2 HINGE: CONTINUOUS, CONCEALED.
  - 3 LATCH: STAINLESS STEEL SCREWDRIVER OPERATED CAM LATCH
  - 4 FINISH: STEEL: 5-STAGE IRON PHOSPHATE PREPARATION WITH PRIME COAT OF WHITE, ALKYD BAKING ENAMEL OR STAINLESS STEEL TYPE 304, NO. 4 SATIN POLISH.
  - 5 MANUFACTURERS: ACUDOR ACONR, CEB, MIFAB, CENDRES CONTOUR
- 3 SUPPORTS & ANCHORS
- 3.1 PIPE HANGERS AND SUPPORTS
- A. APPROVED MANUFACTURERS: ANVIL, MYAT
- B. PLUMBING PIPING – DRAIN, WASTE, AND VENT:
- 1 CONFORM TO ASME B31.9.
  - 2 HANGERS FOR PIPE SIZES 1/2" TO 1-1/2" (15 TO 40 MM): MALLEABLE IRON, ADJUSTABLE SWIVEL, SPLIT RING.
  - 3 MULTIPLE OR TRAPEZE HANGERS: STEEL CHANNELS WITH WELDED SPACERS AND HANGER RODS.
  - 4 WALL SUPPORT FOR PIPE SIZES TO 3-1/4" (80 MM): CAST IRON HOOK.
  - 5 COPPER PIPE SUPPORT: CARBON STEEL RING, ADJUSTABLE, COPPER PLATED.
- C. PLUMBING PIPING – WATER:
- 1 CONFORM TO ASME B31.9.
  - 2 HANGERS FOR PIPE SIZES 1/2" TO 1-1/2" (15 TO 40 MM): MALLEABLE IRON, ADJUSTABLE SWIVEL, SPLIT RING.
  - 3 MULTIPLE OR TRAPEZE HANGERS: STEEL CHANNELS WITH WELDED SUPPORTS OR SPACERS AND HANGER RODS.
  - 4 MULTIPLE OR TRAPEZE HANGERS FOR HOT PIPE SIZES 6" (150 MM) AND OVER: STEEL CHANNELS WITH WELDED SUPPORTS OR SPACERS AND HANGER RODS, CAST IRON ROLL.
  - 5 WALL SUPPORT FOR PIPE SIZES TO 3-1/4" (80 MM): CAST IRON HOOK.
  - 6 VERTICAL SUPPORT: STEEL RISER CLAMP.
  - 7 FLOOR SUPPORT FOR COLD PIPE: CAST IRON ADJUSTABLE PIPE SADDLE, LOCK NUT, NIPPLE, FLOOR FLANGE, AND CONCRETE PIER OR STEEL SUPPORT.
  - 8 COPPER PIPE SUPPORT: CARBON STEEL RING, ADJUSTABLE, COPPER PLATED.
- D. HYDRONIC PIPING:
- 1 CONFORM TO CSA B-51 AND ASME B31.9.
  - 2 HANGERS FOR PIPE SIZES 1/2" TO 1-1/2" (13 TO 38 MM): CARBON STEEL, ADJUSTABLE SWIVEL, SPLIT RING.
  - 3 HANGERS FOR COLD PIPE SIZES 2" (50 MM) AND OVER: CARBON STEEL, ADJUSTABLE, CLEVIS.
  - 4 HANGERS FOR HOT PIPE SIZES 2" TO 4" (50 TO 100 MM): CARBON STEEL, ADJUSTABLE, CLEVIS.
  - 5 MULTIPLE OR TRAPEZE HANGERS: STEEL CHANNELS WITH WELDED SPACERS AND HANGER RODS.
  - 6 FLOOR SUPPORT FOR COLD PIPE: CAST IRON ADJUSTABLE PIPE SADDLE, LOCK NUT, NIPPLE, FLOOR FLANGE, AND CONCRETE PIER OR STEEL SUPPORT.
  - 7 COPPER PIPE SUPPORT: CARBON STEEL RING, ADJUSTABLE, COPPER PLATED.
  - 8 COPPER PIPE SUPPORT: CARBON STEEL RING, ADJUSTABLE, COPPER PLATED.
- E. REFRIGERANT PIPING:
- 1 CONFORM TO ASME B31.5.
  - 2 HANGERS FOR PIPE SIZES 1/2" TO 1-1/2" (13 TO 38 MM): CARBON

## MECHANICAL SPECIFICATIONS – GENERAL

- STEEL ADJUSTABLE SWIVEL, SPLIT RING.
- 3 HANGERS FOR PIPE SIZES 2" (50 MM) AND OVER: CARBON STEEL, ADJUSTABLE, CLEVIS.
  - 4 MULTIPLE OR TRAPEZE HANGERS: STEEL CHANNELS WITH WELDED SPACERS AND HANGER RODS.
  - 5 WALL SUPPORT FOR PIPE SIZES TO 3" (75 MM): CAST IRON HOOK.
  - 6 WALL SUPPORT FOR PIPE SIZES 4" (100 MM) AND OVER: WELDED STEEL BRACKET AND WROUGHT STEEL CLAMP.
  - 7 VERTICAL SUPPORT: STEEL RISER CLAMP.
  - 8 FLOOR SUPPORT: CAST IRON ADJUSTABLE PIPE SADDLE, LOCK NUT, NIPPLE, FLOOR FLANGE, AND CONCRETE PIER OR STEEL SUPPORT.
  - 9 COPPER PIPE SUPPORT: CARBON STEEL RING, ADJUSTABLE, COPPER PLATED.
- 3.2 ACCESSORIES
- A. HANGER RODS: GALVANIZED, CARBON STEEL CONTINUOUS THREADED.
- B. INSERTS: MALLEABLE IRON CASE OF GALVANIZED STEEL SHELL AND EXPANDER PLUG FOR THREADED CONNECTION WITH LATERAL ADJUSTMENT, TOP SLOT FOR REINFORCING RODS, LUGS FOR ATTACHING TO FORMS; SIZE INSERTS TO SUIT THREADED HANGER ROD.
- 3.3 EQUIPMENT ROOF CURBS
- A. FABRICATION: WELDED 0.05" (1.2 MM) GALVANIZED STEEL SHELL AND BASE, MITRED 3" (75 MM) CANT, VARIABLE STEP TO MATCH ROOF INSULATION, FACTORY INSTALLED WOOD NAILER.
- 3.4 ROOFTOP PIPE/DUCT SUPPORTS
- A. ACCEPTABLE MANUFACTURERS: PORTABLE PIPE HANGERS, INC, UNISTRUT
- B. PRE-ENGINEERED PIPE/DUCT SUPPORT SYSTEM INCLUDING:
- 1 BASES: WEATHER RESISTANT AND UV RADIATION RESISTANT WITH SEISMIC ATTACHMENTS
  - 2 FRAMING: 1-5/8" (41.3MM) STRUT OR 1-7/8" (47.6MM) STRUT, FABRICATED OF STEEL TO ASTM A570, GRADE 33, ROLL FORMED OF 12-GAUGE (2.7MM THICK) STEEL INTO 3-SIDED OR TUBULAR SHAPE.
  - 3 PIPE SUPPORTS AND HANGERS: CONFORM TO MSS SP-58 AND MSS SP-59, FABRICATED OF CARBON STEEL. SINGLE ROLLER SUPPORTS FOR PIPING SUBJECT TO EXPANSION AND CONTRACTION.
  - 4 FINISHES:
    - 1 PLASTICS AS MOULDED WITH UV RADIATION PROTECTION.
    - 2 METAL SURFACES HOT DIP GALVANIZED FREE OF ROUGHNESS, WHISKERS, UNSIGHTLY SPANGLERS, DICLES, RUNS, BARBS, SAGS, DROPLETS AND OTHER SURFACE BLEMISHES. GALVANIZING SHALL CONFORM TO ASTM A123 FOR TUBING AND TO ASTM A153 FOR HARDWARE AND ACCESSORIES.
- 3.5 PIPE HANGER SPACING:
- | PIPE SIZE (IN) | ROD DIAMETER (IN) | SUPPORT SPACING (FT) |             |
|----------------|-------------------|----------------------|-------------|
|                |                   | STEEL PIPE           | COPPER TUBE |
| 1/2            | 3/8               | 7                    | 6           |
| 3/4            | 3/8               | 7                    | 6           |
| 1              | 3/8               | 7                    | 6           |
| 1-1/4          | 3/8               | 7                    | 6           |
| 1-1/2          | 3/8               | 9                    | 8           |
| 2              | 3/8               | 10                   | 9           |
- 3.6 DUCT HANGER SPACING:
- | DUCT SIZES (LARGEST SIDE) | ANGLE SIZE             | ROD SIZE      | SPACING |
|---------------------------|------------------------|---------------|---------|
| UP TO 30"                 | 1" X 1" X 1/8"         | 1/4" DIAMETER | 10 FT   |
| 31" TO 42"                | 1-1/2" X 1-1/2" X 1/8" | 1/4" DIAMETER | 10 FT   |
| 43" TO 60"                | 1-1/2" X 1-1/2" X 1/8" | 3/8" DIAMETER | 10 FT   |
| 61" TO 84"                | 2" X 2" 1/8"           | 3/8" DIAMETER | 8 FT    |
- 3.7 FUEL GAS PIPE HANGER SPACING:
- | PIPE SIZE (IN) | SUPPORT SPACING (FT) |
|----------------|----------------------|
| 1/2            | 6                    |
| 3/4 - 1        | 8                    |
| 1-1/4 - 2-1/2  | 10                   |
| 3 - 4          | 15                   |
| 5 - 8          | 20                   |
| 10 OR LARGER   | 25                   |
- EVERY FLOOR
- TUBING (ALL SIZES) 6

## HVAC SPECIFICATIONS

- 1 HVAC HYDRONIC PIPING
- 1.1 HYDRONIC PIPING – GENERAL:
- A. KEEP OPEN ENDS OF PIPE FREE FROM SCALE AND DIRT. PROTECT OPEN ENDS WITH TEMPORARY PLUGS OR CAPS. AFTER COMPLETION, FILL, CLEAN, AND TREAT SYSTEMS.
- B. PROVIDE NON-CONDUCTING DIELECTRIC CONNECTIONS WHENEVER JOINING DISSIMILAR METALS IN OPEN SYSTEMS.
- C. PRIME COAT EXPOSED STEEL HANGERS AND SUPPORTS. HANGERS AND SUPPORTS LOCATED IN CRAWL SPACES, PIPE SHAFTS, AND SUSPENDED CEILING SPACES ARE NOT CONSIDERED EXPOSED.
- D. AIR VENTS SHALL BE SELECTED TO SUIT THE SYSTEM OPERATING PRESSURES AND SHALL BE AUTOMATIC AND COMPLETE WITH ISOLATING VALVES.
- E. PIPE ALL DISCHARGE FROM TEMPERATURE & PRESSURE SAFETY RELIEF VALVES TO A POINT OF SAFE DISCHARGE DIRECTLY INTO A FLOOR DRAIN, HUB DRAIN OR SAFE OUTDOOR LOCATION.
- F. AUTOMATIC FEED VALVES: PROVIDE AUTOMATIC FEED VALVE ON THE COLD WATER MAKE-UP LINE TO EACH NEW HOT WATER HEATING SYSTEM.
- G. TEST LIQUID HEAT TRANSFER PIPING HYDROSTATICALLY AT NOT LESS THAN 150% OF OPERATING PRESSURE OR NOT LESS THAN 125 PSI (860 KPA) WHICH EVER IS THE GREATER. TEST PERIOD SHALL BE NOT LESS THAN SIX (6) HOURS DURATION DURING WHICH TIME EACH JOINT SHALL BE INSPECTED, GIVEN A SHARP TAP WITH A HAMMER AND CHECKED FOR LEAKS.
- 1.2 VALVES – GENERAL
- A. CONFORM TO REQUIREMENTS OF ANSI, ASTM, ASME, AND APPLICABLE MSS STANDARDS.
- B. MANUFACTURER'S NAME AND PRESSURE RATING CLEARLY MARKED ON BODY TO MSS-SP-25.
- C. VALID CRM (CANADIAN REGISTRATION NUMBER) REQUIRED FOR EACH VALVE.
- D. MATERIALS:
- 1 BRONZE: ASTM B62 OR B61 AS APPLICABLE
  - 2 BRASS: ASTM B283 C3770
  - 3 CAST IRON: ASTM A126 CLASS B
- E. END CONNECTIONS:
- 1 THREADED ENDS: ANSI B1.20.1
  - 2 FLANGED ENDS: ANSI B16.1 (CLASS 125), ANSI B16.5
  - 3 FACE-TO-FACE DIMENSIONS: ANSI B16.10
- F. DESIGN AND TESTING:

## HVAC SPECIFICATIONS

- 1 BRONZE GATE & CHECK VALVES: MSS-SP-80
  - 2 BALL VALVES: MSS-SP-110
  - 3 CAST IRON GATE VALVES: MSS-SP-70
  - 4 CAST IRON GLOBE VALVES: MSS-SP-85
  - 5 CAST IRON CHECK: MSS-SP-71
  - 6 BUTTERFLY VALVES: MSS-SP-67
- G. ACCEPTABLE MANUFACTURERS: KITZ, CRANE, JENKINS, CONBRACO, NIBCO
- 1.3 HYDRONIC SYSTEMS TO 150 PSIG, ABOVE GROUND
- A. NOMINAL OPERATING PRESSURE 125 PSIG
- B. DESIGN PRESSURE 150 PSIG
- C. TEST PRESSURE 225 PSIG
- D. DESIGN TEMPERATURE 350°F
- E. CORROSION ALLOWANCE 0.0625 IN.
- F. STEEL PIPE ASTM A53 GR.B ERW OR ASTM A106 GR.B SMLS, SCH 40
- G. JOINTS, 2" AND SMALLER SCREWED
- H. SCREWED FITTINGS 150 LB. MALLEABLE IRON
- I. UNIONS CL.150, ASTM A-47 MALLEABLE IRON, ASTM A-153 GALVANIZED, ANSI B2.1 THREADS.
- J. JOINTS 2-1/2" AND LARGER WELDED, WITH FLANGES AT CONNECTIONS TO EQUIPMENT
- K. BOLT WELD FITTINGS ASTM A234 GR. WFB
- L. FLANGES ASTM A105, CLASS 150, RAISED FACE, WELD NECK OR SLIP ON
- M. BOLTS ASTM A307 C.S. BOLTS, SQ. HEAD; ASTM A563 NUTS, HEX HEAD
- N. GASKETS 1/16" (1.6 MM) THICK PREFORMED, NON-ASBESTOS GRAPHITE FIBRE
- O. COPPER TUBING 2" AND SMALLER ASTM B88, TYPE L, HARD DRAWN.
- P. JOINTS: SOLDER, LEAD FREE, ASTM B32, 95-5 TIN-ANTIMONY, OR TIN AND SILVER, WITH MELTING RANGE 220°C TO 280°C. ASME B16.18, CAST BRASS, OR ASME B16.22, SOLDER WROUGHT COPPER
- R. DIELECTRIC UNIONS: UNION WITH GALVANIZED OR PLATED STEEL, THREADED END, COPPER SOLDER END, WATER IMPERVIOUS ISOLATION BARRIER.
- S. VALVES, 2" AND SMALLER: ASTM A105
- 1 GATE VALVES (ISOLATING) 300 PSIG NON-SHOCK WOG, ASTM B62 BRONZE BODY, SOLID WEDGE DISC, RISING STEM, BRONZE TRIM, THREADED ENDS, KITZ #25
  - 2 GLOBE VALVES (THROTTLING) 300 PSIG NON-SHOCK WOG, ASTM B62 BRONZE BODY, COMPOSITION (TEFLON) DISC, RISING STEM, BRONZE TRIM, THREADED ENDS, KITZ #09
  - 3 CHECK VALVES (BACKFLOW) 300 PSIG NON-SHOCK WOG, ASTM B62 BRONZE BODY, Y-PATTERN HORIZONTAL, SWING TYPE DISC, THREADED ENDS, KITZ #29
  - 4 BALL VALVES (DRAIN) 600 PSIG NON-SHOCK WOG, FORGED BRASS, 2-PIECE, CHECK BALL AND STEEL BODY. BLOW-OUT PROOF PIPE SEALS & STEM, LEVER HANDLE, THREADED ENDS, KITZ #68AC.
- T. PROVIDE STEM EXTENSIONS FOR INSULATED PIPING.
- U. PROVIDE GEAR OPERATOR AND CHAIN ON VALVES INSTALLED ABOVE 10-FT AFF.
- V. STRAINERS, 2" AND SMALLER CLASS 250, 400 PSIG WOG, CAST IRON BODY, Y-PATTERN, SCREWED CAP AND ENDS; A167 304 STAINLESS STEEL SCREEN WITH 1/32" PERFORATIONS; MUELLER STEAM 11M.
- W. STRAINERS, 2-1/2" AND LARGER CLASS 250 PSIG NON-SHOCK WOG, CAST IRON, Y-PATTERN, BOLTED FLANGE, BLOW-OUT PLUG, A167 304 STAINLESS STEEL SCREEN WITH 1/32" PERFORATIONS, FLANGED ENDS, MUELLER STEAM 752
- 1.4 CIRCUIT BALANCING VALVES: 2" (50 MM) AND SMALLER)
- A. CIRCUIT BALANCING VALVES: 2" (50 MM) AND SMALLER)
- 1 SCREWED CONNECTION, GLOBE STYLE DESIGN, NONFERROUS, PRESSURE DIE-CAST, NONPOROUS METAL COPPER ALLOY. EACH VALVE SHALL BE SUCH THAT WHEN INSTALLED IN ANY DIRECTION, IT WILL NOT AFFECT FLOW MEASUREMENT.
  - 2 VALVES SHALL PROVIDE THE FOLLOWING FUNCTIONS:
    - 1 PRECISE FLOW MEASUREMENT.
    - 2 PRECISION FLOW BALANCING.
    - 3 POSITIVE SHUT OFF WITH NO DRIP SEAT AND TEFLON DISC.
    - 4 DRAIN CONNECTION WITH PROTECTIVE CAP.
  - 3 VALVES SHALL HAVE FOUR 360° ADJUSTMENT TURNS OF HANDWHEEL FOR MAXIMUM VERNIER-TYPE SETTING WITH "HIDDEN MEMORY" FEATURE TO PROGRAM THE VALVE WITH PRECISION TAMPER-PROOF BALANCING SETTING.
  - 4 VALVES SHALL BE SHIPPED IN A 4.5 R FACTOR POLYURETHANE CONTAINER THAT SHALL BE USED AS INSULATION AFTER VALVE IS INSTALLED.
  - 5 PROVIDE VALVES SUITABLE FOR MAXIMUM WORKING PRESSURE OF 250 PSI (1720 KPA) AND MAXIMUM OPERATING TEMPERATURE OF 250°F (121°C).
  - 6 ACCEPTABLE PRODUCTS: S.A. ARMSTRONG CRV I INDICATED OR TOUR & ANDERSON STA-D OR NEWMAN HATTERSLEY.
- 1.5 VICTALUC SERIES 799/79V KOIL-KIT™ COIL PACK
- A. INSTALL SERIES 786, 787 OR 788 TOUR & ANDERSSON BALANCING VALVE, VICTALUC SERIES 78U UNION PORT FITTING, SERIES 78Y STRAINER/BALL VALVE OR SERIES 78T UNION/BALL VALVE COMBINATION, AND TWO STAINLESS STEEL FLEXIBLE HOSES TO COMPLETE TERMINAL HOOKUP AT COIL OUTLET. VICTALUC SERIES 799 OR SERIES 79V WITH ATC VALVE.
- 2 HVAC DUCT INSULATION
- 2.1 GLASS FIBRE, FLEXIBLE
- A. MANUFACTURER: CERTAINTED SOFT TOUCH AND WIDE WRAP
- B. OTHER ACCEPTABLE MANUFACTURERS: JOHNS MANVILLE MICROLITE.
- C. INSULATION: ASTM C553; ASTM C1290, CAN 51.11-92, ASTM C1136, NFPA 90A, ASTM E84; ASTM E136.
- 1 'KSI' VALUE : ASTM C518, 0.039 at 24 °C ( 0.27 @ 75.2 °F )
  - 2 MAXIMUM SERVICE TEMPERATURE: 121 °C (250 °F )
  - 3 MAXIMUM MOISTURE ABSORPTION: ASTM C1104; <5% BY WEIGHT.
  - 4 MAXIMUM FLAME SPREAD INDEX: 25
  - 5 MAXIMUM SMOKE DEV INDEX: 50
- D. VAPOUR BARRIER JACKET:
- 1 KRAFT PAPER WITH GLASS FIBRE YARN AND BONDED TO ALUMINIZED FILM. (FSK)
  - 2 KRAFT PAPER REINFORCED WITH GLASS FIBRE YARN AND BONDED TO WHITE METALIZED POLYPROPYLENE
  - 3 MOISTURE VAPOUR TRANSMISSION: ASTM E96; 0.02 PERM.
  - 4 SECURE WITH PRESSURE SENSITIVE TAPE.
- E. VAPOUR BARRIER TAPE:
- 1 KRAFT PAPER REINFORCED WITH GLASS FIBRE YARN AND BONDED TO ALUMINIZED FILM, WITH PRESSURE SENSITIVE RUBBER BASED ADHESIVE.
- F. OUTDOOR VAPOUR BARRIER MASTIC:
- 1 VINYL EMULSION TYPE ACRYLIC OR MASTIC, COMPATIBLE WITH INSULATION, BLACK COLOUR.
- G. THE WIRE: ANNEALED STEEL, 1/16" (1.5 MM).
- 2.2 GLASS FIBRE, RIGID
- A. MANUFACTURER: CERTAINTED CERTAPRO BOARD.
- B. OTHER ACCEPTABLE MANUFACTURERS: JOHNS MANVILLE 800 SERIES SPIN-GLASS
- C. INSULATION: ASTM C612; RIGID, NONCOMBUSTIBLE BLANKET.
- 1 'KSI' VALUE : ASTM C518, 0.25 BTU-in/Hr-Sq.Ft- F at 75 F (0.036 W/M- C at 24 °C)
  - 2 MAXIMUM SERVICE TEMPERATURE: 250 °F (121 °C).
  - 3 MAXIMUM MOISTURE ABSORPTION: ASTM C1104; <5% BY WEIGHT.

## HVAC SPECIFICATIONS

- D. VAPOUR BARRIER JACKET:
- 1 KRAFT PAPER WITH GLASS FIBRE YARN AND BONDED TO ALUMINIZED FILM.
  - 2 MOISTURE VAPOUR TRANSMISSION: ASTM E96; 0.04 PERM.
  - 3 SECURE WITH PRESSURE SENSITIVE TAPE.
- 2.3 DUCT INSULATION
- A. INSULATE NEW OR ALTERED DUCTWORK AND RE-INSULATE EXISTING DUCTWORK WHERE INSULATION HAS BEEN REMOVED OR DAMAGED AS FOLLOWS:
- | SERVICE                                    | INSULATION TYPE | THICKNESS |
|--|-----------------|-----------|
| AIR SUPPLY – RECTANGULAR                   | RIGID           | 1"        |
| AIR SUPPLY – ROUND                         | FLEXIBLE        | 1"        |
| EXHAUST WITHIN 6' OF OUTSIDE – RECTANGULAR | RIGID           | 3"        |
| EXHAUST WITHIN 6' OF OUTSIDE – ROUND       | FLEXIBLE        | 3"        |
| FRESH AIR INTAKE – RECTANGULAR             | RIGID           | 3"        |
| FRESH AIR INTAKE – ROUND                   | FLEXIBLE        | 3"        |
3. HVAC PIPING INSULATION
- 3.1 GLASS FIBRE
- A. APPROVED MANUFACTURERS: JOHNSMANVILLE MICRO-LOK
- B. OTHER ACCEPTABLE MANUFACTURERS OFFERING EQUIVALENT PRODUCTS: OWENS CORING FIBERGLASS, CERTAINTED CERTAPRO
- C. INSULATION: ASTM C547; ASTM C411, ASTM C356 ASTM E84, ASTM D774, NFPA 259.
- 1 'KSI' VALUE : 0.23 BTU-in/Hr-Sq.Ft-F at 75°F, 0.33 W/m- C at 24 °C
  - 2 MINIMUM SERVICE TEMPERATURE: 0°F (-18°C).
  - 3 MAXIMUM SERVICE TEMPERATURE: 850°F (454°C).
  - 4 MAXIMUM MOISTURE ABSORPTION: <5% BY WEIGHT.
- D. VAPOUR BARRIER JACKET
- 1 ASTM C136 TYPE I, WHITE KRAFT PAPER REINFORCED WITH GLASS FIBRE YARN AND BONDED TO ALUMINIZED FILM.
  - 2 MOISTURE VAPOUR TRANSMISSION: ASTM E96; 0.02 PERM.
  - 3 SECURE WITH SELF SEALING LONGITUDINAL LAPS AND BUTT STRIPS.
  - 4 SECURE WITH OUTWARD CLINCH EXPANDING STAPLES AND VAPOUR BARRIER MASTIC
- E. TIE WIRE: 1.3 MM STAINLESS STEEL WITH TWISTED ENDS ON MAXIMUM 12" (300 MM) CENTRES
- F. VAPOUR BARRIER LAP ADHESIVE
- 1 COMPATIBLE WITH INSULATION.
- G. INSULATING CEMENT/MASTIC
- 1 ASTM C195; HYDRAULIC SETTING ON MINERAL WOOL, VOC CONTENT NOT TO EXCEED 80 G/L.
- H. FIBROUS GLASS FABRIC
- 1 CLOTH: UNTREATED; 9 OZ/SQ YD (305 G/SQ M) WEIGHT.
  - 2 BLANKET: 1.0 LB/CU FT (16 KG/CU M) DENSITY.
- I. INDOOR VAPOUR BARRIER FINISH
- 1 VINYL EMULSION TYPE ACRYLIC, COMPATIBLE WITH INSULATION, WHITE COLOUR, VOC CONTENT NOT TO EXCEED 250 G/L.
- J. OUTDOOR VAPOUR BARRIER MASTIC
- 1 VINYL EMULSION TYPE ACRYLIC, COMPATIBLE WITH INSULATION, WHITE COLOUR.
- K. INSULATING CEMENT
- 1 ASTM C449, VOC CONTENT NOT TO EXCEED 80 G/L.
- 3.2 JACKETS
- A. PVC PLASTIC
- 1 JACKET: ONE PIECE MOULDED TYPE FITTING COVERS AND SHEET MATERIAL. ASTM E84, ASTM D1784, UL1502-M8B.
  - 2 MAXIMUM SERVICE TEMPERATURE: 151°F (66°C).
  - 3 FINISH: GLOSS.
  - 4 MAXIMUM FLAME SPREAD: ASTM E84; 25 OR LESS.
  - 5 MAXIMUM SMOKE DEVELOPED: ASTM E84; 50 OR LESS.
  - 6 THICKNESS: 20 MIL (0.4 MM) MINIMUM, 30 MIL (0.8 MM) MINIMUM FOR OUTDOOR USE.
  - 7 COLOUR: STANDARD OFF-WHITE
  - 8 COVERING ADHESIVE MASTIC
  - 9 COMPATIBLE WITH INSULATION, MAXIMUM VOC CONTENT OF 50 G/L
- B. ALUMINUM JACKET, ASTM E84. (APPLY TO ALL EXTERIOR PIPING ONLY)
- 1 THICKNESS: ASTM C1729 REQUIREMENTS FOR RIGID AND NON-RIGID INSULATION FINISH.
  - 2 FINISH: SMOOTH PLAIN MILL FINISH.
  - 3 JOINING: LONGITUDINAL SLIP JOINTS AND 2" (50 MM) LAPS.
  - 4 FITTINGS: 0.02" (0.40 MM) THICK DIE SHAPED FITTING COVERS WITH FACTORY ATTACHED PROTECTIVE LINER.
  - 5 METAL JACKET BANDS: 3/8" (10 MM) WIDE; 0.01" (0.38 MM) THICK ALUMINUM.
- 3.3 PIPE INSULATION
- A. INSULATE NEW OR ALTERED PIPING WITH RIGID PIPE INSULATION AND RE-INSULATE EXISTING PIPING WHERE INSULATION HAS BEEN REMOVED OR DAMAGED AS FOLLOWS:
- | SERVICE                                     | OPERATING TEMP.(°F) | PIPE DIAMETER IN. | THK. IN. |
|---|---------------------|-------------------|----------|
| HYDRONIC HEATING (HOT WATER & GLYCOL/WATER) |                     |                   |          |



## FIRE PROTECTION SPECIFICATIONS

- GENERAL**
- GENERAL REQUIREMENT**
  - COOPERATE WITH OTHER TRADES WHOSE WORK AFFECTS OR IS AFFECTED BY WORK OF THIS DIVISION TO ENSURE SATISFACTORY INSTALLATION AND TO AVOID DELAYS. MATERIALS TO BE BUILT-IN SUCH AS SLEEVES, ANCHORS, ETC., TOGETHER WITH ACCURATE DIMENSIONS OR TEMPLATES, PROMPTLY.
  - PROVIDE FIRE EXTINGUISHERS WHERE INDICATED AND IN CONFORMANCE WITH THE ONTARIO FIRE CODE AND NFPA 10.
    - PROVIDE 10 LB. (4.54 KG) MULTI-PURPOSE EXTINGUISHERS IN EACH FIRE HOSE CABINET AND IN MECHANICAL ROOMS.
- FIRE EXTINGUISHERS**
- ACCEPTABLE MANUFACTURERS**
  - NATIONAL FIRE EQUIPMENT, FLAG, KENT, PYRENE CANADA, CFH, SAFETY SUPPLY CHUBB
- MULTI-PURPOSE DRY CHEMICAL**
  - TYPE: MULTI-PURPOSE (ABC) TYPE, DRY CHEMICAL
  - SIZE: 5 LB. (2.27 KG)
  - RATING: MINIMUM 3A:10BC.  
OR  
A. TYPE: MULTI-PURPOSE (ABC) TYPE, DRY CHEMICAL  
B. SIZE: 10 LB. (4.54 KG)  
C. RATING: MINIMUM 4A:50BC

## PLUMBING SPECIFICATIONS

- PLUMBING PIPING — GENERAL**
  - VERIFY THAT EXCAVATIONS ARE TO REQUIRED GRADE, DRY, AND NOT OVER-EXCAVATED.
  - BEAM PIPE AND FLANGE ENDS. REMOVE BURRS. BEVEL PLAIN END FERROUS PIPE. REMOVE SCALE AND DIRT, ON INSIDE AND OUTSIDE, BEFORE ASSEMBLY. PREPARE PIPING FITTINGS TO EQUIPMENT WITH FLANGES OR UNIONS.
  - PROVIDE NON-CONDUCTING DIELECTRIC CONNECTIONS WHEREVER JOINING DISSIMILAR METALS.
  - PROVIDE ACCESS WHERE VALVES AND FITTINGS ARE NOT EXPOSED. COORDINATE SIZE AND LOCATION OF ACCESS DOORS WITH GENERAL TRADES.
  - INSTALL VENT PIPING PENETRATING ROOFED AREAS TO MAINTAIN INTEGRITY OF ROOF ASSEMBLY.
  - SUPPORT VERTICAL PIPING AT EVERY OTHER FLOOR. SUPPORT RISER PIPING INDEPENDENTLY OF CONNECTED HORIZONTAL PIPING.
  - PRIME COAT EXPOSED STEEL HANGERS AND SUPPORTS. HANGERS AND SUPPORTS LOCATED IN CRAWL SPACES, PIPE SHEDS, AND SUSPENDED CEILING SPACES ARE NOT CONSIDERED EXPOSED.
  - SUPPORT CAST IRON DRAINAGE PIPING AT EVERY JOINT.
  - DO HYDROSTATIC TESTING PRIOR TO BACKFILLING OVER JOINTS
  - DISINFECT ALL NEW AND ALTERED WATER DISTRIBUTION PIPING.
  - VERIFY THAT PIPING SYSTEM IS COMPLETE AND HAS BEEN FLUSHED, CLEANED, INSPECTED, AND PRESSURE TESTED.
  - ISOLATE EXISTING PIPING TO FULL EXTENT POSSIBLE. ENSURE THAT ALL FIXTURES, EXISTING AND NEW THAT ARE SERVED FROM PIPING BEING DISINFECTED, ARE TAKEN OUT OF SERVICE AND SIGNS ARE PLACED AT EACH FIXTURE PROHIBITING USE DURING THE DISINFECTION PERIOD.
  - DISINFECT PH OF WATER TO BE TREATED IS BETWEEN 7.4 AND 7.6 BY ADDING ALKALI (CAUSTIC SODA OR SODA ASH) OR ACID (HYDROCHLORIC). INJECT DISINFECTANT, FREE CHLORINE IN LIQUID, POWDER, TABLET OR GAS FORM, THROUGHOUT SYSTEM TO OBTAIN 50 TO 80 MG/L RESIDUAL.
- SANITARY SEWER PIPING, BURIED**
  - CAST IRON PIPE: ASTM A74 EXTRA HEAVY WEIGHT.
    - FITTINGS: CAST IRON.
    - JOINTS: HUB-AND-SPIGOT, CISPI HSN COMPRESSION TYPE WITH ASTM C564 NEOPRENE GASKETS
  - CAST IRON PIPE: CISPI 301, HUBLESS.
    - FITTINGS: CAST IRON.
    - JOINTS: CISPI 310, NEOPRENE GASKET AND STAINLESS STEEL CLAMP AND SHIELD ASSEMBLIES.
  - COPPER TUBE: ASTM B306, DWV.
    - FITTINGS: ASME B16.23, CAST BRONZE, OR ASME B16.29, WROUGHT COPPER.
    - JOINTS: ASTM B32, SOLDER, GRADE 50B.
  - ABS PIPE: ASTM D2751 OR ASTM F628.
    - FITTINGS: ABS.
    - JOINTS: ASTM D2235, SOLVENT WELD.
  - ABS PIPE: ASTM D2661 OR ASTM D2751.
    - FITTINGS: ABS.
    - JOINTS: ASTM D2235, SOLVENT WELD.
  - PVC PIPE: ASTM D2665 OR ASTM D3034.
    - FITTINGS: PVC.
    - JOINTS: ASTM D2855, SOLVENT WELD WITH ASTM D2564 SOLVENT CEMENT.
  - PVC PIPE: ASTM D2665, ASTM D3034, OR ASTM F679.
    - FITTINGS: PVC.
    - JOINTS: ASTM F477, ELASTOMERIC GASKETS.
- SANITARY SEWER PIPING, ABOVE GRADE**
  - CAST IRON PIPE: ASTM A74, SERVICE WEIGHT.
    - FITTINGS: CAST IRON.
    - JOINTS: ASTM C564, NEOPRENE GASKET SYSTEM
  - CAST IRON PIPE: CISPI 301, HUBLESS, SERVICE WEIGHT.
    - FITTINGS: CAST IRON.
    - JOINTS: CISPI 310, NEOPRENE GASKETS AND STAINLESS STEEL CLAMP-AND-SHIELD ASSEMBLIES.
  - COPPER TUBE: ASTM B306, DWV.
    - FITTINGS: ASME B16.23, CAST BRONZE, OR ASME B16.29, WROUGHT COPPER, OR ASME B16.32, SOVENT.
    - JOINTS: ASTM B32, SOLDER, GRADE 50B.
- SANITARY SEWER PIPING, ABOVE GRADE (URINALS ONLY)**
  - COPPER TUBING: ASTM B88M, TYPE K, HARD DRAWN.
    - FITTINGS: ASME B18.18 CAST COPPER ALLOY OR ASME B16.22, WROUGHT COPPER AND BRONZE.
    - JOINTS: ASTM B32, SOLDER, GRADE 95TA
- SANITARY VENT PIPING, BURIED**
  - CAST IRON PIPE: ASTM A74 EXTRA HEAVY WEIGHT.
    - FITTINGS: CAST IRON.
    - JOINTS: HUB-AND-SPIGOT, CISPI HSN COMPRESSION TYPE WITH ASTM C564 NEOPRENE GASKETS OR LEAD AND OAKUM.
  - CAST IRON PIPE: CISPI 301, HUBLESS.
    - FITTINGS: CAST IRON.
    - JOINTS: CISPI 310, NEOPRENE GASKET AND STAINLESS STEEL CLAMP AND SHIELD ASSEMBLIES.
  - COPPER TUBE: ASTM B306, DWV.
    - FITTINGS: ASME B16.23, CAST BRONZE, OR ASME B16.29, WROUGHT COPPER.
    - JOINTS: ASTM B32, SOLDER, GRADE 50B.
- SANITARY VENT PIPING, ABOVE GRADE**
  - CAST IRON PIPE: ASTM A74, SERVICE WEIGHT.
    - FITTINGS: CAST IRON.
    - JOINTS: ASTM C564, NEOPRENE GASKET SYSTEM
  - CAST IRON PIPE: CISPI 301, HUBLESS, SERVICE WEIGHT.
    - FITTINGS: CAST IRON.
    - JOINTS: CISPI 310, NEOPRENE GASKETS AND STAINLESS STEEL CLAMP-AND-SHIELD ASSEMBLIES.
  - COPPER TUBE: ASTM B306, DWV.
    - FITTINGS: ASME B16.23, CAST BRONZE, OR ASME B16.29, WROUGHT COPPER.
    - JOINTS: ASTM B32, SOLDER, GRADE 50B.

## PLUMBING SPECIFICATIONS

- OR ASME B16.32, SOVENT.
- JOINTS: ASTM B32, SOLDER, GRADE 50B.
- WATER PIPING, ABOVE GRADE**
    - DOMESTIC HOT AND COLD WATER.
      - COPPER TUBING: ASTM B88M, TYPE L, HARD DRAWN.
        - FITTINGS: ASME B16.18, CAST COPPER ALLOY OR ASME B16.22, WROUGHT COPPER AND BRONZE.
        - JOINTS: ASTM B32, SOLDER, GRADE 95TA.
      - DOMESTIC HOT WATER RE-CIRCULATION.
        - COPPER TUBING: ASTM B88M, TYPE L, SOFT ANNEALED.
          - FITTINGS: ASME B18.18 CAST COPPER ALLOY OR ASME B16.22, WROUGHT COPPER AND BRONZE.
          - JOINTS: ASTM B32, SOLDER, GRADE 95TA.
    - ACID WASTE PIPING, BURIED & ABOVE GRADE**
      - WATTS ORION BLUELINE  
THE CORROSIVE WASTE DRAINAGE SYSTEM, CONFORMING TO ASTM F1412, SHALL BE WATTS ORION'S BLUELINE FLAME RETARDANT PIPE AND FITTINGS. THE PIPE IS SUPPLIED IN 10 FT. LENGTHS. THE PIPING & FITTINGS WILL MEET OR EXCEED SCHEDULE 40 DIMENSIONS. THE POLYPROPYLENE MATERIAL WILL CONFORM TO ASTM D4101.
        - FITTINGS/JOINTS: PIPE AND FITTINGS WILL BE JOINED USING THE ORION SOCKET FUSION SYSTEM CONFORMING TO ASTM D2657.
    - FLANGES, UNIONS, AND COUPLINGS**
      - PIPE SIZE 3-1/4" (80 MM) AND UNDER:
        - FERROUS PIPE: CLASS 150 MALLEABLE IRON THREADED UNIONS.
        - COPPER TUBE AND PIPE: CLASS 150 BRONZE UNIONS WITH SOLDERED JOINTS.
      - PIPE SIZE OVER 1" (25 MM):
        - FERROUS PIPE: CLASS 150 MALLEABLE IRON THREADED OR FORGED STEEL SLIP-ON FLANGES; PREFORMED NEOPRENE GASKETS.
        - COPPER TUBE AND PIPE: CLASS 150 SLIP-ON BRONZE FLANGES; PREFORMED NEOPRENE GASKETS.
      - GROOVED AND SHOULDERED PIPE END COUPLINGS:
        - HOUSING: MALLEABLE IRON CLAMPS TO ENGAGE AND LOCK, DESIGNED TO PERMIT SOME ANGULAR DEFLECTION, CONTRACTION, AND EXPANSION; STEEL BOLTS, NUTS, AND WASHERS; GALVANIZED FOR GALVANIZED PIPE.
        - SEALING GASKET: "C" SHAPE COMPOSITION SEALING GASKET.
      - DIELECTRIC CONNECTIONS: UNION WITH GALVANIZED OR PLATED STEEL THREADED END, COPPER SOLDER END, WATER IMPERVIOUS ISOLATION BARRIER.
    - VALVES — GENERAL**
      - CONFORM TO REQUIREMENTS OF ANSI, ASTM, ASME, AND APPLICABLE MSS STANDARDS.
      - MANUFACTURER'S NAME AND PRESSURE RATING CLEARLY MARKED ON BODY TO MSS-SP-25.
      - VALID CRN (CANADIAN REGISTRATION NUMBER) ISSUED BY PROVINCE OF ONTARIO REQUIRED FOR EACH VALVE.
      - MATERIALS:
        - BRONZE: ASTM B62 OR B61 AS APPLICABLE
        - BRASS: ASTM B283 C3770
        - CAST IRON: ASTM A126 CLASS B
      - END CONNECTIONS:
        - FLANGED ENDS: ANSI B16.1 (CLASS 125), ANSI B16.5
        - FACE-TO-FACE DIMENSIONS: ANSI B16.10
    - ISOLATION VALVES**
      - UP TO AND INCLUDING 2" (50MM) — BALL TYPE
        - MANUFACTURER: KITZ #69MML
        - CONSTRUCTION: MSS SP-110, CLASS 150, 600 PSI (4140 KPA) CWP, FORGED BRASS, TWO PIECE BODY, STAINLESS STEEL BALL AND STEM, FULL PORT, VIRGIN PTFE SEATS AND STEM PACKING, BLOW-OUT PROOF STEM, LEVER HANDLE WITH BALANCING STOPS, STEM EXTENSIONS FOR INSULATED PIPING, SOLDER ENDS.
    - DRAIN VALVES**
      - UP TO 150 PSIG — BALL TYPE:
        - MANUFACTURERS: KITZ 68C
        - CONSTRUCTION: 150 PSIG (1034 KPA), 600 WOG, BRASS BODY TO ASTM C37700, TWO PIECE BODY, FULL PORT, PTFE SEATS AND STEM PACKING OR DOUBLE "O" RING, BLOW-OUT PROOF STEM, CHROME PLATED BALL, LEVER HANDLE WITH CAP AND CHAIN, (3/4") 20 MM HOSE CONNECTION.
    - STRAINERS**
      - UP TO 125 PSIG:
        - SIZE 2" (50 MM) AND UNDER:
          - MANUFACTURERS: MUELLER STEAM 351M
          - CONSTRUCTION: 860 KPA (125 PSIG)/ 200 WOG RATING, BRONZE BODY, SCREWED CAP, Y PATTERN, 304 STAINLESS STEEL SCREEN WITH 20 MESH PERFORATION, THREADED ENDS.
        - SIZE 2-1/2" (65 MM) AND LARGER:
          - MANUFACTURERS: MUELLER STEAM 758
          - CONSTRUCTION: 860 KPA (125 PSIG)/ 200 WOG RATING, CAST IRON BODY, BOLTED COVER, 304 STAINLESS STEEL SCREEN WITH 1/16 & 1/8 PERFORATION, THREADED ENDS.
      - UP TO 250 PSIG:
        - SIZE 2" (50 MM) AND UNDER:
          - MANUFACTURERS: MUELLER STEAM 11M
          - CONSTRUCTION: CLASS 250, 400 PSIG WOG, CAST IRON BODY, Y-PATTERN, SCREWED CAP AND ENDS, A167 304 STAINLESS STEEL SCREEN WITH 1/32" PERFORATIONS.
        - SIZE 2-1/2" (65 MM) AND LARGER:
          - MANUFACTURERS: MUELLER STEAM 758
          - CONSTRUCTION: 300 PSIG NON-SHOCK WOG, CAST IRON, Y-PATTERN, BOLTED COVER, BLOW-OUT PLUG, A167 304 STAINLESS STEEL SCREEN WITH 1/32" PERFORATIONS, FLANGED ENDS.
    - PLUMBING PIPING INSULATION**
    - GENERAL INSTALLATION**
      - FINISHES: EXPOSED INDOORS: PVC JACKET. CONCEALED, INDOORS: CANVAS ON VALVES, FITTINGS. NO FURTHER FINISH. USE VAPOUR RETARDER JACKET ON TAC CODE A-3 INSULATION COMPATIBLE WITH INSULATION. FINISH ATTACHMENTS: SS, BANDS, AT 150 MM ON CENTRE. SEALS: CLOSED.
    - GLASS FIBRE**
      - APPROVED MANUFACTURERS: JOHNSMANVILLE MICRO-LOK
      - OTHER ACCEPTABLE MANUFACTURERS OFFERING EQUIVALENT PRODUCTS: OWENS CORING FIBERGLASS, CERTANTEED CRIMPWRAP
      - INSULATION: ASTM C547; ASTM C411, ASTM C356 ASTM E84, ASTM D774, NFPA 259.
        - "KSI" VALUE : 0.23 BTU-in/hr-Sq.Ft-F AT 75°F, 0.33 W/m-m C AT 24 °C.
        - MINIMUM SERVICE TEMPERATURE: 0°F (-18°C).
        - MAXIMUM SERVICE TEMPERATURE: 850°F (454°C).
        - MAXIMUM MOISTURE ABSORPTION: <5% BY WEIGHT.
      - VAPOUR BARRIER JACKET
        - ASTM C136 TYPE I, WHITE KRAFT PAPER REINFORCED WITH GLASS FIBRE YARN AND BONDED TO ALUMINIZED FLM.
        - MOISTURE VAPOUR TRANSMISSION: ASTM E96; 0.02 PERM.

## PLUMBING SPECIFICATIONS

- SECURE WITH SELF SEALING LONGITUDINAL LAPS AND BUTT STRIPS.
  - SECURE WITH OUTWARD CLINCH EXPANDING STAPLES AND VAPOUR BARRIER MASTIC
- THE WIRE: 1.5 MM STAINLESS STEEL WITH TWISTED ENDS ON MAXIMUM 12" (300 MM) CENTRE
- VAPOUR BARRIER LAP ADHESIVE
    - COMPATIBLE WITH INSULATION.
  - INSULATING CEMENT/MASTIC
    - ASTM C195; HYDRAULIC SETTING ON MINERAL WOOL. VOC CONTENT NOT TO EXCEED 80 G/L.
  - FIBROUS GLASS FABRIC
    - CLOTH: UNTREATED; 9 OZ/SQ YD (305 G/SQ M) WEIGHT.
    - BLANKET: 1.0 LB/CU FT (16 KG/CU M) DENSITY.
  - INDOOR VAPOUR BARRIER FINISH
    - VINYL EMULSION TYPE ACRYLIC, COMPATIBLE WITH INSULATION, WHITE COLOUR, VOC CONTENT NOT TO EXCEED 250 G/L.
  - OUTDOOR VAPOUR BARRIER MASTIC
    - VINYL EMULSION TYPE ACRYLIC, COMPATIBLE WITH INSULATION, WHITE COLOUR.
  - INSULATING CEMENT
    - ASTM C449, VOC CONTENT NOT TO EXCEED 80 G/L.
- JACKETS (APPLY TO ALL INTERIOR EXPOSED PIPING ONLY)**
    - PVC PLASTIC
      - JACKET: ONE PIECE MOULDED TYPE FITTING COVERS AND SHEET MATERIAL. ASTM E84, ASTM D1784, ULC S102-M88.
      - MAXIMUM SERVICE TEMPERATURE: 151°F (66°C).
      - FINISH: GLOSS.
      - MAXIMUM FLAME SPREAD: ASTM E84; 25 OR LESS.
      - MAXIMUM SMOKE DEVELOPED: ASTM E84; 50 OR LESS.
      - THICKNESS: 20 MIL (0.4 MM) MINIMUM. 30 MIL (0.8 MM) MINIMUM FOR OUTDOOR USE.
      - COLOUR: STANDARD OFF-WHITE
      - COVERING ADHESIVE MASTIC
        - COMPATIBLE WITH INSULATION, MAXIMUM VOC CONTENT OF 50 G/L.
        - APPROVED MANUFACTURER: CEEL-CO 300 SERIES, ZESTON PVC
    - ALUMINUM JACKET: ASTM E84. (APPLY TO ALL EXTERIOR PIPING ONLY)
      - THICKNESS: ASTM C1729 REQUIREMENTS FOR RIGID AND NON-RIGID INSULATION FINISH.
      - FINISH: SMOOTH PLAIN MILL FINISH.
      - JOINING: LONGITUDINAL SLIP JOINTS AND 2" (50 MM) LAPS.
      - FITTINGS: .02" (0.40 MM) THICK DIE SHAPED FITTING COVERS WITH FACTORY ATTACHED PROTECTIVE LINER.
      - METAL JACKET BANDS: 3/8" (10 MM) WIDE, 0.01" (0.38 MM) THICK ALUMINUM.
  - PIPE INSULATION THICKNESS**
    - INSULATE NEW OR ALTERED PIPING WITH RIGID PIPE INSULATION AND RE-INSULATE EXISTING PIPING WHERE INSULATION HAS BEEN REMOVED OR DAMAGED AS FOLLOWS:
      - RIGID PIPE INSULATION  
OPERATING TEMP. RANGE °F PIPE DIAMETER IN. INSULATION THK. IN.  
DOMESTIC COLD WATER TO 850 ALL SIZES 1  
DOMESTIC HOT WATER & DHW RECIRCULATION 105 TO 140 1-1/4 & SMALLER 1
      - SANITARY DRAINAGE 40 TO 55 1-1/2 & LARGER 1-1/2
      - STORM DRAINAGE 40 TO 55 ALL SIZES 1
  - PLUMBING AND DRAINAGE TESTING**
    - AFTER ALL PIPES HAVE BEEN PLACED IN POSITION AND ALL BRANCHES INSTALLED, BUT BEFORE FIXTURES HAVE BEEN SET OR CONNECTED, TEST THE TIGHTNESS OF ALL JOINTS AND THE SOUNDNESS OF ALL PIPES.
      - MAKE ALL TESTS BEFORE PIPING IS FURRED IN.
      - NOTIFY CONSULTANT AT LEAST 48 HOURS BEFORE COMMENCING WITH TEST, AND GIVE CONSULTANT A WRITTEN CERTIFICATE CONFIRMING THESE TESTS.
    - STORM, SANITARY, WASTE, AND VENT PIPING: SECURELY CLOSE ALL OPENINGS IN PIPE ENDS THROUGHOUT THE WORK BY MEANS OF APPROVED PLUGS AND FILL THE ENTIRE PIPING SYSTEM, INCLUDING STACKS, BRANCHES TO FIXTURES AND ALL HORIZONTAL RUNS WITH WATER. TEST BY RUNNING WATER INTO ALL PIPES, FIXTURES, TRAPS, AND APPARATUS IN ORDER TO DETECT ANY IMPERFECT MATERIAL OR WORKMANSHIP. WHERE IT IS IMPOSSIBLE TO TEST THE WHOLE SYSTEM AT ONE TIME, DIVIDE INTO PARTS. PERFORM THE WATER TEST IN ACCORDANCE WITH SECTION 7.3 OF OBC. PERFORM AN AIR TEST OR FINAL TEST OR ANY OTHER TEST REQUIRED BY AUTHORITIES HAVING JURISDICTION.
    - TEST ALL WATER LINES HYDROSTATICALLY AT 1-1/2 TIMES THE WORKING PRESSURE BUT AT NOT LESS THAN 1,380 KPA (200 PSI), FORA PERIOD OF NOT LESS THAN TWO (2) HOURS WITHOUT ANY DROP IN PRESSURE. DO TESTING BEFORE PIPING IS BURIED OR FURRED IN AND BEFORE PRESSURE SENSITIVE DEVICES ARE INSTALLED IN THE PIPEWORK. CORRECT ALL DEFECTS DISCLOSED BY TESTS. RETEST UNTIL ALL RESULTS ARE ACCEPTABLE.
  - IF ANY LEAKS ARE DISCOVERED BY THE ABOVE TESTS, REMOVE AND REPLACE THE FAULTY PORTIONS OF THE SYSTEMS AND REPEAT THE TEST. REPEAT THIS PROCEDURE UNTIL THE SYSTEM IS ACCEPTED BY THE CONSULTANT'S REPRESENTATIVE ON THE SITE. DO NOT CAULK THREADED JOINTS.
  - SHUT OFF PIPING DOWN IN DIRECTION OF FLOW TO LOW POINTS. USE CENTRIC REDUCERS AT PIPE SIZE CHANGES INSTALLED FOT TO PROVIDE POSITIVE DRAINAGE.
  - PROVIDE GAS VALVES TO PERMIT ISOLATION OF BRANCH PIPING AND EACH EQUIPMENT ITEM FROM THE BALANCE OF THE SYSTEM AND TO ALLOW SAFE AND CONVENIENT ACCESS WITHOUT MOVING EQUIPMENT AND WITH A MINIMUM OF PIPING AND EQUIPMENT DISASSEMBLY.
    - INSTALL SHUTOFF VALVES AT THE FOLLOWING LOCATIONS: MAIN GAS CONNECTION BEFORE ENTERING BUILDING.
    - BRANCH GAS PIPING SERVING EACH ITEM OF EQUIPMENT OR APPLIANCE. OUTSIDE MECHANICAL ROOMS CONTAINING GAS FIRED EQUIPMENT. ALL BRANCH GAS LINES FROM GAS RISER
  - MASTER GAS SHUT-OFF VALVES:** SOLENOID WITH ZERO DIFFERENTIAL 120V/1/60 0-5 PSI MAX WORKING PRESSURE TOUGHENED DIE CAST ALUMINUM BODY FLUSH MOUNT ENCLOSURE C/W HINGES AND LATCHING SYSTEM
  - MASTER GAS SHUT-OFF CONTROLLER:** CGS MERLIN 1000S RANGE C/W GAS SOLENOID VALVE. BUILT-IN EMERGENCY SHUTOFF PUSH BUTTON. 120 VAC. WALL MOUNTED
- PLUMBING FIXTURES AND TRIM**
  - S-1**

DSE125221-01125 635 x 559 x 205 MM (25 x 22 x 8 1/16") STAINLESS STEEL SINGLE BOWL SINK, 635 x 559 x 205 MM (25 x 22 x 8 1/16 IN), TYPE 301, 20 GAUGE, SATIN FINISH, SOUND DEADENING PADS, RIM SEAL PRE-INSTALLED, INSTALLATION KIT, 89 MM (3 1/2 IN) REAR CENTERED BASKET STRAINER ASSEMBLY, PRE-DRILLED SINGLE CENTER HOLE, Z82581-XL POLISHED CHROME-PLATED SINGLE LABORATORY FAUCET WITH INTEGRAL SHANK, QUARTER TURN CERAMIC DISC CARTRIDGE AND A 137 MM (5 3/8 IN) CENTERLINE RIGID OR SWING GOOSENECK SPOUT, B.3 L (2.2 USGPM), PRESSURE COMPENSATING AERATOR, 64 MM (2 1/2 IN) VANDAL RESISTANT COLOR-CODED METAL LEVER HANDLES, MOUNTING HARDWARE AND A 1/2" COUPLING NUT. ZH8824X-L-RLRQ-8860-12-PC (2) 10 X 300 MM (3/8 X 12") EXTRA HEAVY DUTY QUARTER TURN STOPS, LOW LEAD, DN 1/2 IN COMPRESSION, LOOSE KEY, VERTICAL FLEXIBLE STAINLESS BRAIDED HOSES OF 10 X 300 MM (3/8 X 12 IN), FLANGE, CHROME PLATED FINISH. Z8702-89D 38 MM (1 1/2") CAST BRASS ADJUSTABLE P-TRAP, 38 MM (1 1/2 IN) WITH CLEANOUT, DEEP SEAL FLANGE, POLISHED CHROME FINISH. FOR ACID USE SINKS PROVIDE WATTS ORION BLUELINE ACID RESISTANT 1-1/2" P-TRAP (SINKS UPSTREAM OF ACID NEUTRALIZATION TANK SHOWN ON DRAWINGS)

PIPE SIZES: 1/2" DCW & DHW INLET, 1-1/2" DRAIN OUTLET
  - EW-1**

ENCON 01035401 WALL MOUNTED EMERGENCY EYEWASH OR EYE/FACE WASH, 274 MM (10.8") YELLOW ABS RECEPTOR, LAMINAR FLOW EYEWASH, YELLOW ABS EYEWASH HEAD WITH WATER PRESSURE ACTIVATED YELLOW PLASTIC POP-OFF DUST COVER, INTEGRAL 12 L/MIN (3.2 USGPM) FLOW CONTROL, CHROME-PLATED BRASS STAY-OPEN BALL VALVE EQUIPPED WITH STAINLESS STEEL BALL AND STEM, PUSH FLAG ACTIVATED SIGN, 18 STAINLESS MESH SCREEN (1190 MICRONS) IN-LINE FILTER, DN 1/2" WATER SUPPLY, CAST-ALUMINUM CHROMATE PROTECTED WALL BRACKET, SATIN FINISH CHROME PLATED DN 1 1/4" WASTE, WITH UNIVERSAL PICTOGRAM OPERATING PRESSURE IS 30-70 PSI. PRODUCT'S NOTES : NOTE : FORESEE FAIL-SAFE PRE-MIXED WATER SYSTEM. TA-300-LF-RF WARNING: AN EMERGENCY EQUIPMENT REQUIRES BETWEEN 30 AND 90 PSI ACCORDING TO ANSI REQUIREMENTS. CONSIDERATION MUST BE TAKEN FOR PRESSURE LOSS THROUGHOUT THE MIXING VALVE. BRONZE DURA-TROL® SOLID BI-METAL THERMOSTAT COMPENSATING FOR TEMPERATURE AND

## PLUMBING SPECIFICATIONS

- JOINTS: ANSI B31.1 WELDED.
  - JACKET: AWWA C105 POLYETHYLENE OR DOUBLE LAYER, HALF-LAPPED 0.25 MM POLYETHYLENE TAPE.
- ABOVE GROUND PIPING**
    - COPPER TUBING: ASTM B88, TYPE K, HARD DRAWN.
      - FITTINGS: ASME B16.18, CAST COPPER ALLOY OR ASTM B16.22 WROUGHT COPPER AND BRONZE.
      - JOINTS: AWS A5.8 CLASSIFICATION BCUP-3 OR BCUP-4 SILVER BRAZE.
    - STEEL PIPE: ASTM A53/A53M GR. B, ERW OR A106 SMLS, SCHEDULE 40.
      - FITTINGS: ASTM B16.3, MALLEABLE IRON CLASS 150, SCREWED OR FLANGED OR ASTM A234/A234M, WROUGHT CARBON STEEL AND ALLOY STEEL WELDING TYPE.
      - JOINTS: NFPA 30, THREADED, FLANGED OR WELDED TO ANSI B31.1.
        - SCREWED FITTINGS: PULVERIZED LEAD PASTE.
      - WELDED FITTINGS: BUTT-WELDING FITTINGS TO CSA W47.1.
      - FLANGE GASKETS: NONMETALLIC FLAT, TO ASME B16.5.
      - UNIONS: MALLEABLE IRON, BRASS TO IRON, GROUND SEAT, TO ASTM A 47/A47M.
        - BOLTS AND NUTS: TO ASME B18.2.1.
        - PIPPLES: SCHEDULE 40, TO ASTM A 53/A53M.
    - WHERE PIPING IS INSTALLED IN CELINGS AS RETURN AIR PLENUMS, PROVIDE SEAMLESS PIPE AND WELDING FITTINGS.
      - ISOLATION VALVES**
        - 2" (50 MM) AND SMALLER: SEMI-STEEL LUBRICATED PLUG VALVES, SCREWED, WRENCH OPERATED. ROCKWELL "NORDSTRUM" FIG. 142, NEWMAN-MILLIKEN 170M.
        - 2-1/2" (65 MM) AND 3" (75 MM): SEMI-STEEL LUBRICATED PLUG VALVES, FLANGED, WRENCH OPERATED. ROCKWELL "NORDSTRUM" FIG. 143, NEWMAN-MILLIKEN 171M.
        - PROVIDE TWO (2) STANDARD PATTERN, CAST HANDLE WRENCHES TO OPERATE VALVES.
        - PRESSURE REDUCING VALVES**
          - GAS PRESSURE REDUCING AND RELIEF VALVES: SPRING LOADED REGULATOR WITH INTERNAL RELIEF VALVE, CAST IRON BODY, ALUMINUM DIAPHRAGM CASE AND ORIFICE, FOR CAPACITIES REFER TO DRAWINGS. FISHER TYPE 133L OR 133H, OR APPROVED EQUAL, AS NOTED ON DRAWINGS.
        - GAS PIPE TESTING**
          - INSTALL AND TEST GAS PIPING IN COMPLIANCE WITH THE LATEST ISSUE OF THE LOCAL GAS UTILITY REGULATIONS, TSSAB149.1, AND TO THE APPROVAL OF THE LOCAL GAS UTILITY AND LOCAL AUTHORITIES.
          - SUBJECT GAS PIPING TO AN INERT GASES PRESSURE TEST OF 345 KPA (50 PSI) AS PER B149.1 REQUIREMENTS. PURGE AFTER PRESSURE TEST IN ACCORDANCE WITH TSSA B149.1.
          - THE TAGGING OF TESTED GAS PIPING SYSTEMS IS DESCRIBED IN THE REGULATION COVERED BY PARAGRAPH 3.7.1 ABOVE.AFFIX TAGS TO THE PIPING AT POINT OF ENTRY INTO THE BUILDING.
      - IF ANY LEAKS ARE DISCOVERED BY THE ABOVE TESTS, REMOVE AND REPLACE THE FAULTY PORTIONS OF THE SYSTEMS AND REPEAT THE TEST. REPEAT THIS PROCEDURE UNTIL THE SYSTEM IS ACCEPTED BY THE CONSULTANT'S REPRESENTATIVE ON THE SITE. DO NOT CAULK THREADED JOINTS.
      - SLOPE PIPING DOWN IN DIRECTION OF FLOW TO LOW POINTS. USE CENTRIC REDUCERS AT PIPE SIZE CHANGES INSTALLED FOT TO PROVIDE POSITIVE DRAINAGE.
      - PROVIDE GAS VALVES TO PERMIT ISOLATION OF BRANCH PIPING AND EACH EQUIPMENT ITEM FROM THE BALANCE OF THE SYSTEM AND TO ALLOW SAFE AND CONVENIENT ACCESS WITHOUT MOVING EQUIPMENT AND WITH A MINIMUM OF PIPING AND EQUIPMENT DISASSEMBLY.
        - INSTALL SHUTOFF VALVES AT THE FOLLOWING LOCATIONS: MAIN GAS CONNECTION BEFORE ENTERING BUILDING.
        - BRANCH GAS PIPING SERVING EACH ITEM OF EQUIPMENT OR APPLIANCE. OUTSIDE MECHANICAL ROOMS CONTAINING GAS FIRED EQUIPMENT. ALL BRANCH GAS LINES FROM GAS RISER
      - MASTER GAS SHUT-OFF VALVES:** SOLENOID WITH ZERO DIFFERENTIAL 120V/1/60 0-5 PSI MAX WORKING PRESSURE TOUGHENED DIE CAST ALUMINUM BODY FLUSH MOUNT ENCLOSURE C/W HINGES AND LATCHING SYSTEM
      - MASTER GAS SHUT-OFF CONTROLLER:** CGS MERLIN 1000S RANGE C/W GAS SOLENOID VALVE. BUILT-IN EMERGENCY SHUTOFF PUSH BUTTON. 120 VAC. WALL MOUNTED
    - PLUMBING FIXTURES AND TRIM**
      - S-1**

DSE125221-01125 635 x 559 x 205 MM (25 x 22 x 8 1/16") STAINLESS STEEL SINGLE BOWL SINK, 635 x 559 x 205 MM (25 x 22 x 8 1/16 IN), TYPE 301, 20 GAUGE, SATIN FINISH, SOUND DEADENING PADS, RIM SEAL PRE-INSTALLED, INSTALLATION KIT, 89 MM (3 1/2 IN) REAR CENTERED BASKET STRAINER ASSEMBLY, PRE-DRILLED SINGLE CENTER HOLE, Z82581-XL POLISHED CHROME-PLATED SINGLE LABORATORY FAUCET WITH INTEGRAL SHANK, QUARTER TURN CERAMIC DISC CARTRIDGE AND A 137 MM (5 3/8 IN) CENTERLINE RIGID OR SWING GOOSENECK SPOUT, B.3 L (2.2 USGPM), PRESSURE COMPENSATING AERATOR, 64 MM (2 1/2 IN) VANDAL RESISTANT COLOR-CODED METAL LEVER HANDLES, MOUNTING HARDWARE AND A 1/2" COUPLING NUT. ZH8824X-L-RLRQ-8860-12-PC (2) 10 X 300 MM (3/8 X 12") EXTRA HEAVY DUTY QUARTER TURN STOPS, LOW LEAD, DN 1/2 IN COMPRESSION, LOOSE KEY, VERTICAL FLEXIBLE STAINLESS BRAIDED HOSES OF 10 X 300 MM (3/8 X 12 IN), FLANGE, CHROME PLATED FINISH. Z8702-89D 38 MM (1 1/2") CAST BRASS ADJUSTABLE P-TRAP, 38 MM (1 1/2 IN) WITH CLEANOUT, DEEP SEAL FLANGE, POLISHED CHROME FINISH. FOR ACID USE SINKS PROVIDE WATTS ORION BLUELINE ACID RESISTANT 1-1/2" P-TRAP (SINKS UPSTREAM OF ACID NEUTRALIZATION TANK SHOWN ON DRAWINGS)

PIPE SIZES: 1/2" DCW & DHW INLET, 1-1/2" DRAIN OUTLET
      - EW-1**

ENCON 01035401 WALL MOUNTED EMERGENCY EYEWASH OR EYE/FACE WASH, 274 MM (10.8") YELLOW ABS RECEPTOR, LAMINAR FLOW EYEWASH, YELLOW ABS EYEWASH HEAD WITH WATER PRESSURE ACTIVATED YELLOW PLASTIC POP-OFF DUST COVER, INTEGRAL 12 L/MIN (3.2 USGPM) FLOW CONTROL, CHROME-PLATED BRASS STAY-OPEN BALL VALVE EQUIPPED WITH STAINLESS STEEL BALL AND STEM, PUSH FLAG ACTIVATED SIGN, 18 STAINLESS MESH SCREEN (1190 MICRONS) IN-LINE FILTER, DN 1/2" WATER SUPPLY, CAST-ALUMINUM CHROMATE PROTECTED WALL BRACKET, SATIN FINISH CHROME PLATED DN 1 1/4" WASTE, WITH UNIVERSAL PICTOGRAM OPERATING PRESSURE IS 30-70 PSI. PRODUCT'S NOTES : NOTE : FORESEE FAIL-SAFE PRE-MIXED WATER SYSTEM. TA-300-LF-RF WARNING: AN EMERGENCY EQUIPMENT REQUIRES BETWEEN 30 AND 90 PSI ACCORDING TO ANSI REQUIREMENTS. CONSIDERATION MUST BE TAKEN FOR PRESSURE LOSS THROUGHOUT THE MIXING VALVE. BRONZE DURA-TROL® SOLID BI-METAL THERMOSTAT COMPENSATING FOR TEMPERATURE AND

## PLUMBING SPECIFICATIONS

- PRESSURE VARIATIONS. 1.9-38 L/MIN (0.5 – 10 USGPM) FLOW FOR A PRESSURE LOSS UP TO 45 PSI. MAY BE ADJUSTED TO THE DESIRED TEMPERATURE. LOCKING TEMPERATURE REGULATOR TO PREVENT ACCIDENTAL MOVEMENT SET FOR 29 °C (85 °F). MIXING VALVE WILL CLOSE DOWN ON FAILURE OF COLD WATER SUPPLY. MIXING VALVE WITH SPECIAL INTERNAL COLD WATER BY-PASS CAPABLE OF A MINIMUM 15 L/MIN (4 USGPM) AT 30 PSI (2.1 BAR) UPON FAILURE OF HOT WATER. HIGH TEMPERATURE LIMIT STOP FACTORY PRE-SET AT 32 °C (90 °F). INTEGRAL WALL SUPPORT. DN 1/2 IN INLETS WITH ANGLE CHECK STOPS, DN 1/2 IN OUTLET. ROUGH BRONZE FINISH. DAL THERMOMETER. REQUIRED HOT WATER SUPPLY AT 60 °C (140 °F) MIN. COMPLIES TO ANSI Z358.1 2004. OPTION : -TOP TOP INLETS.
- PIPE SIZES: 1/2" DCW & DHW INLET
- EW-2**

ENCON 01050277 COLUMN COMBINATION EMERGENCY DRENCH SHOWER AND EYE/FACE WASH WITH CORROSION RESISTANT COATING, YELLOW ABS SHOWERHEAD WITH INTEGRAL 76 L/MIN (20 USGPM) FLOW CONTROL, 274 MM (10.8") YELLOW ABS RECEPTOR, LAMINAR FLOW EYEWASH, YELLOW ABS EYEWASH HEAD WITH WATER PRESSURE ACTIVATED YELLOW PLASTIC POP-OFF DUST COVER, INTEGRAL 30 L/MIN (8 USGPM) FLOW CONTROL, CHROME-PLATED BRASS STAY-OPEN BALL VALVE EQUIPPED WITH 316 STAINLESS STEEL BALL AND STEM, STAINLESS STEEL TRIANGULAR PULL ROD, PUSH FLAG ACTIVATED SIGN, 16 STAINLESS MESH SCREEN (1190 MICRONS) IN-LINE FILTER, SCH 80 HOT DIP GALVANIZED STEEL, DN 1 1/4 IN DIAM. COLUMN AND FITTINGS, FLOOR FLANGE, DN 1 1/4 IN WATER SUPPLY, DN 1 1/4 IN WASTE, UNIVERSAL PICTOGRAM OPERATING PRESSURE IS 30-70 PSI. ENCON 01120001 ABS DUST COVER. LEONARD TM-600-LF-RF WARNING: AN EMERGENCY EQUIPMENT REQUIRES BETWEEN 30 AND 90 PSI ACCORDING TO ANSI REQUIREMENTS. CONSIDERATION MUST BE TAKEN FOR PRESSURE LOSS THROUGHOUT THE MIXING VALVE. ROUGH BRONZE FINISH DURA-TROL® SOLID BI-METAL THERMOSTAT COMPENSATING FOR TEMPERATURE AND PRESSURE VARIATIONS. 11-220 L/MIN (3-58 USGPM) FLOW FOR A PRESSURE LOSS UP TO 45 PSI. MAY BE ADJUSTED TO THE DESIRED TEMPERATURE. LOCKING TEMPERATURE REGULATOR TO PREVENT ACCIDENTAL MOVEMENT SET FOR 29 °C (85 °F). MIXING VALVE WILL CLOSE DOWN ON FAILURE OF COLD WATER SUPPLY. MIXING VALVE WITH SPECIAL INTERNAL COLD WATER BY-PASS CAPABLE OF A MINIMUM 30 L/MIN (8 USGPM) AT 30 PSI (2.1 BAR) UPON FAILURE OF HOT WATER. HIGH TEMPERATURE LIMIT STOP FACTORY PRESET AT 32 °C (90 °F). INTEGRAL WALL SUPPORT. DN 3/4 IN BOTTOM INLETS WITH ANGLE CHECKSTOPS, DN 1 IN TOP OUTLET. ROUGH BRONZE FINISH. DAL THERMOMETER. REQUIRED HOT WATER SUPPLY AT 60 °C (140 °F) MIN. COMPLIES TO ANSI Z358.1 2004. OPTION : -TOP TOP INLETS.


PIPE SIZES: 1/2" DCW & DHW INLET
  - FD**

ZN211-V5-P CAST IRON FLOOR DRAIN WITH A 165 MM (6 1/2") IN DIAM. BODY WITH A 102 MM (4") IN DIAM. THREADED THROAT TO RECEIVE ADJUSTABLE 127 MM (5") IN DIAM. ADJUSTABLE ROUND STRAINER COMBINED WITH 127 MM (5 X 5") SQUARE POLISHED NICKEL BRONZE REGULAR TRAFFIC GRATE. TRAP PRIMER CONNECTION. 695-01 TRAP PRIMER VALVE WHERE REPLENISHMENT OF WATER IN FLOOR DRAIN TRAPS IS REQUIRED; TRAP PRIMER VALVES SHALL BE 1/2" FIP INLET X 1/2" MIP OUTLET, AUTOMATIC TRAP PRIMER VALVES WHICH ACTIVATE WITH A 10 PSIG PRESSURE DROP BETWEEN 30-150 PSIG. WATER RELEASE SHALL BE FACTORY SET. TRAP PRIMER VALVE SHALL HAVE LARGE PORT OPENINGS AND A NON-CORROSIVE BRASS FINISH.


PIPE SIZES: 1/2





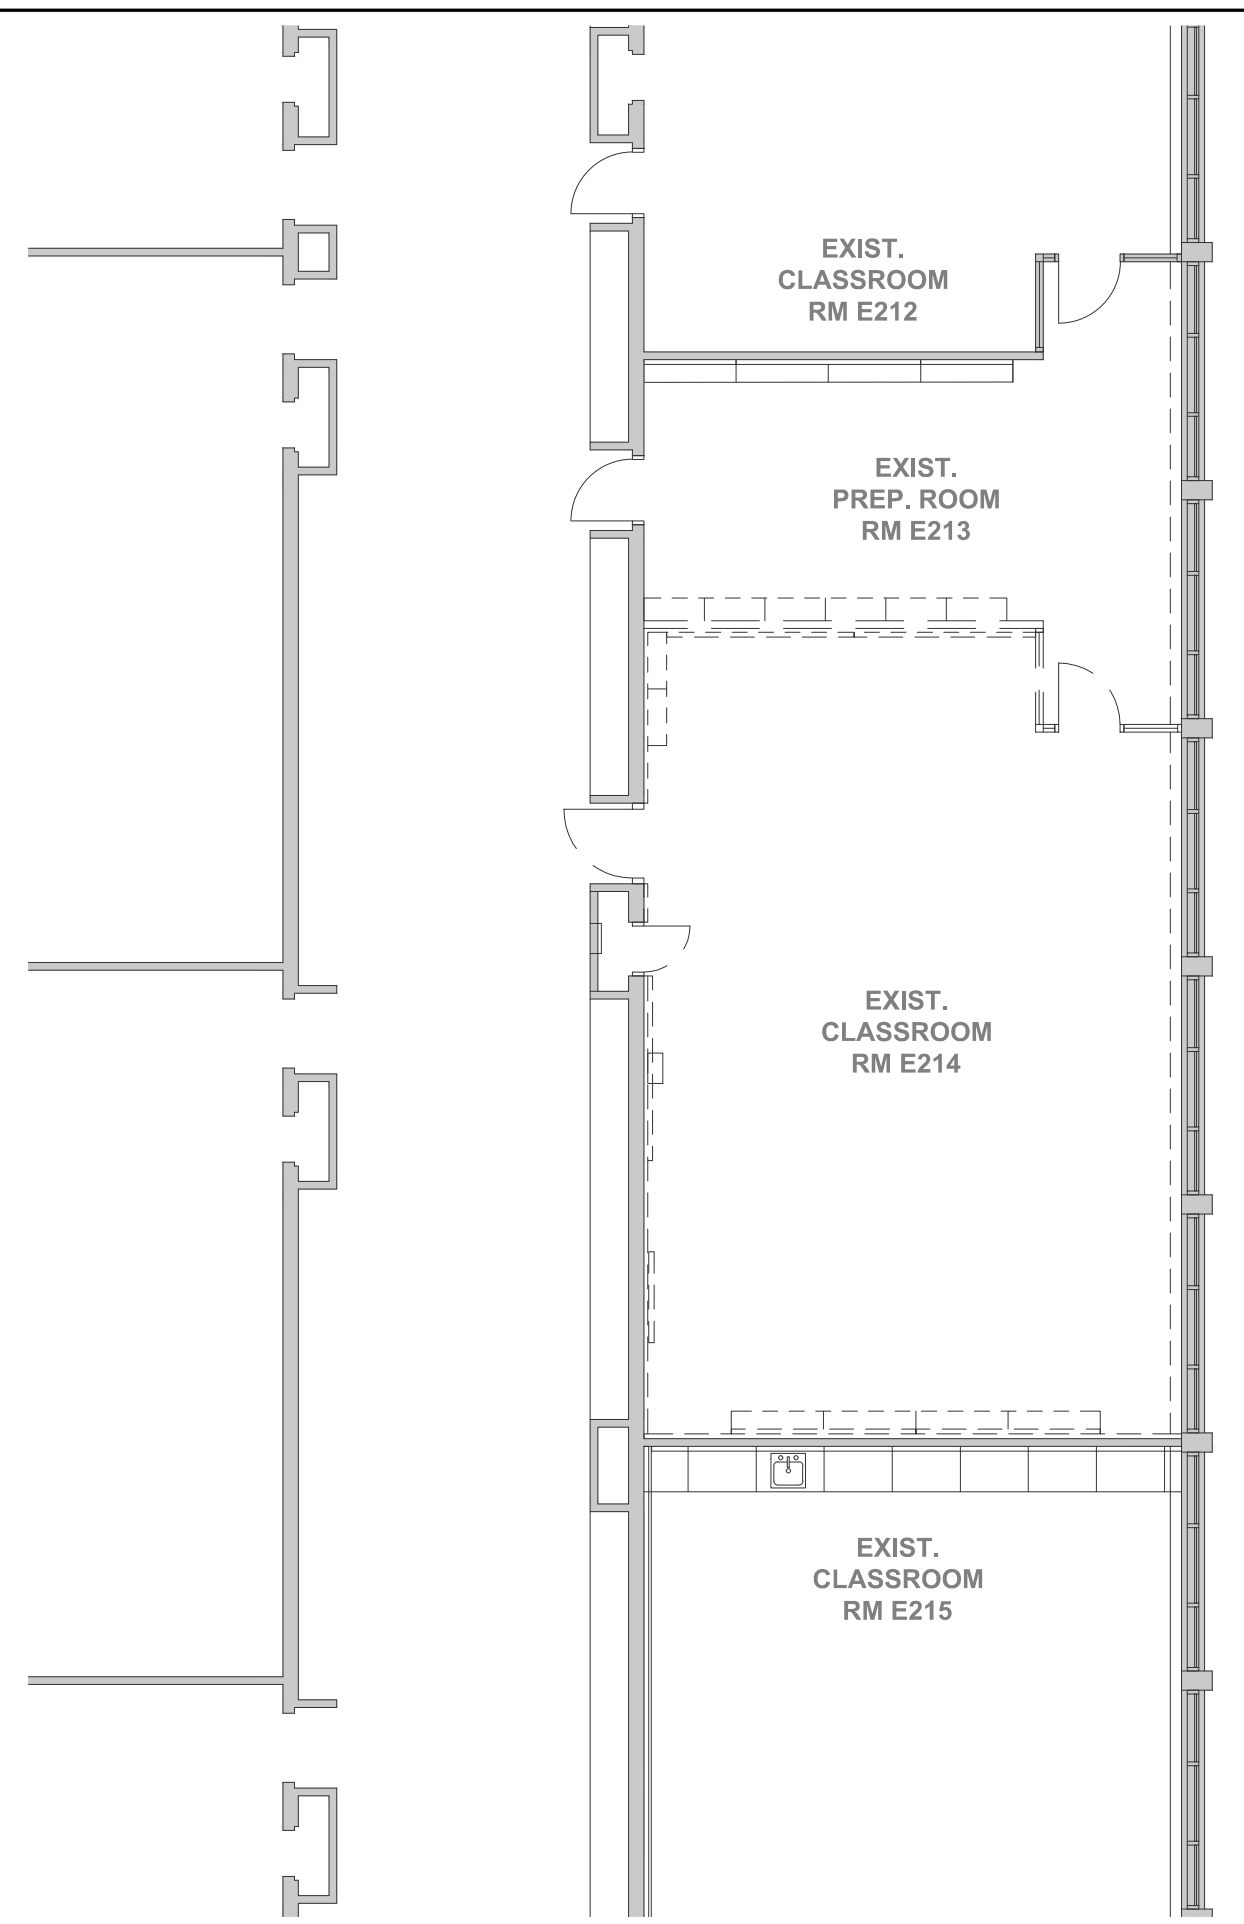

3 AREA 3 - DEMOLITION PLUMBING & DRAINAGE  
M100 1:100

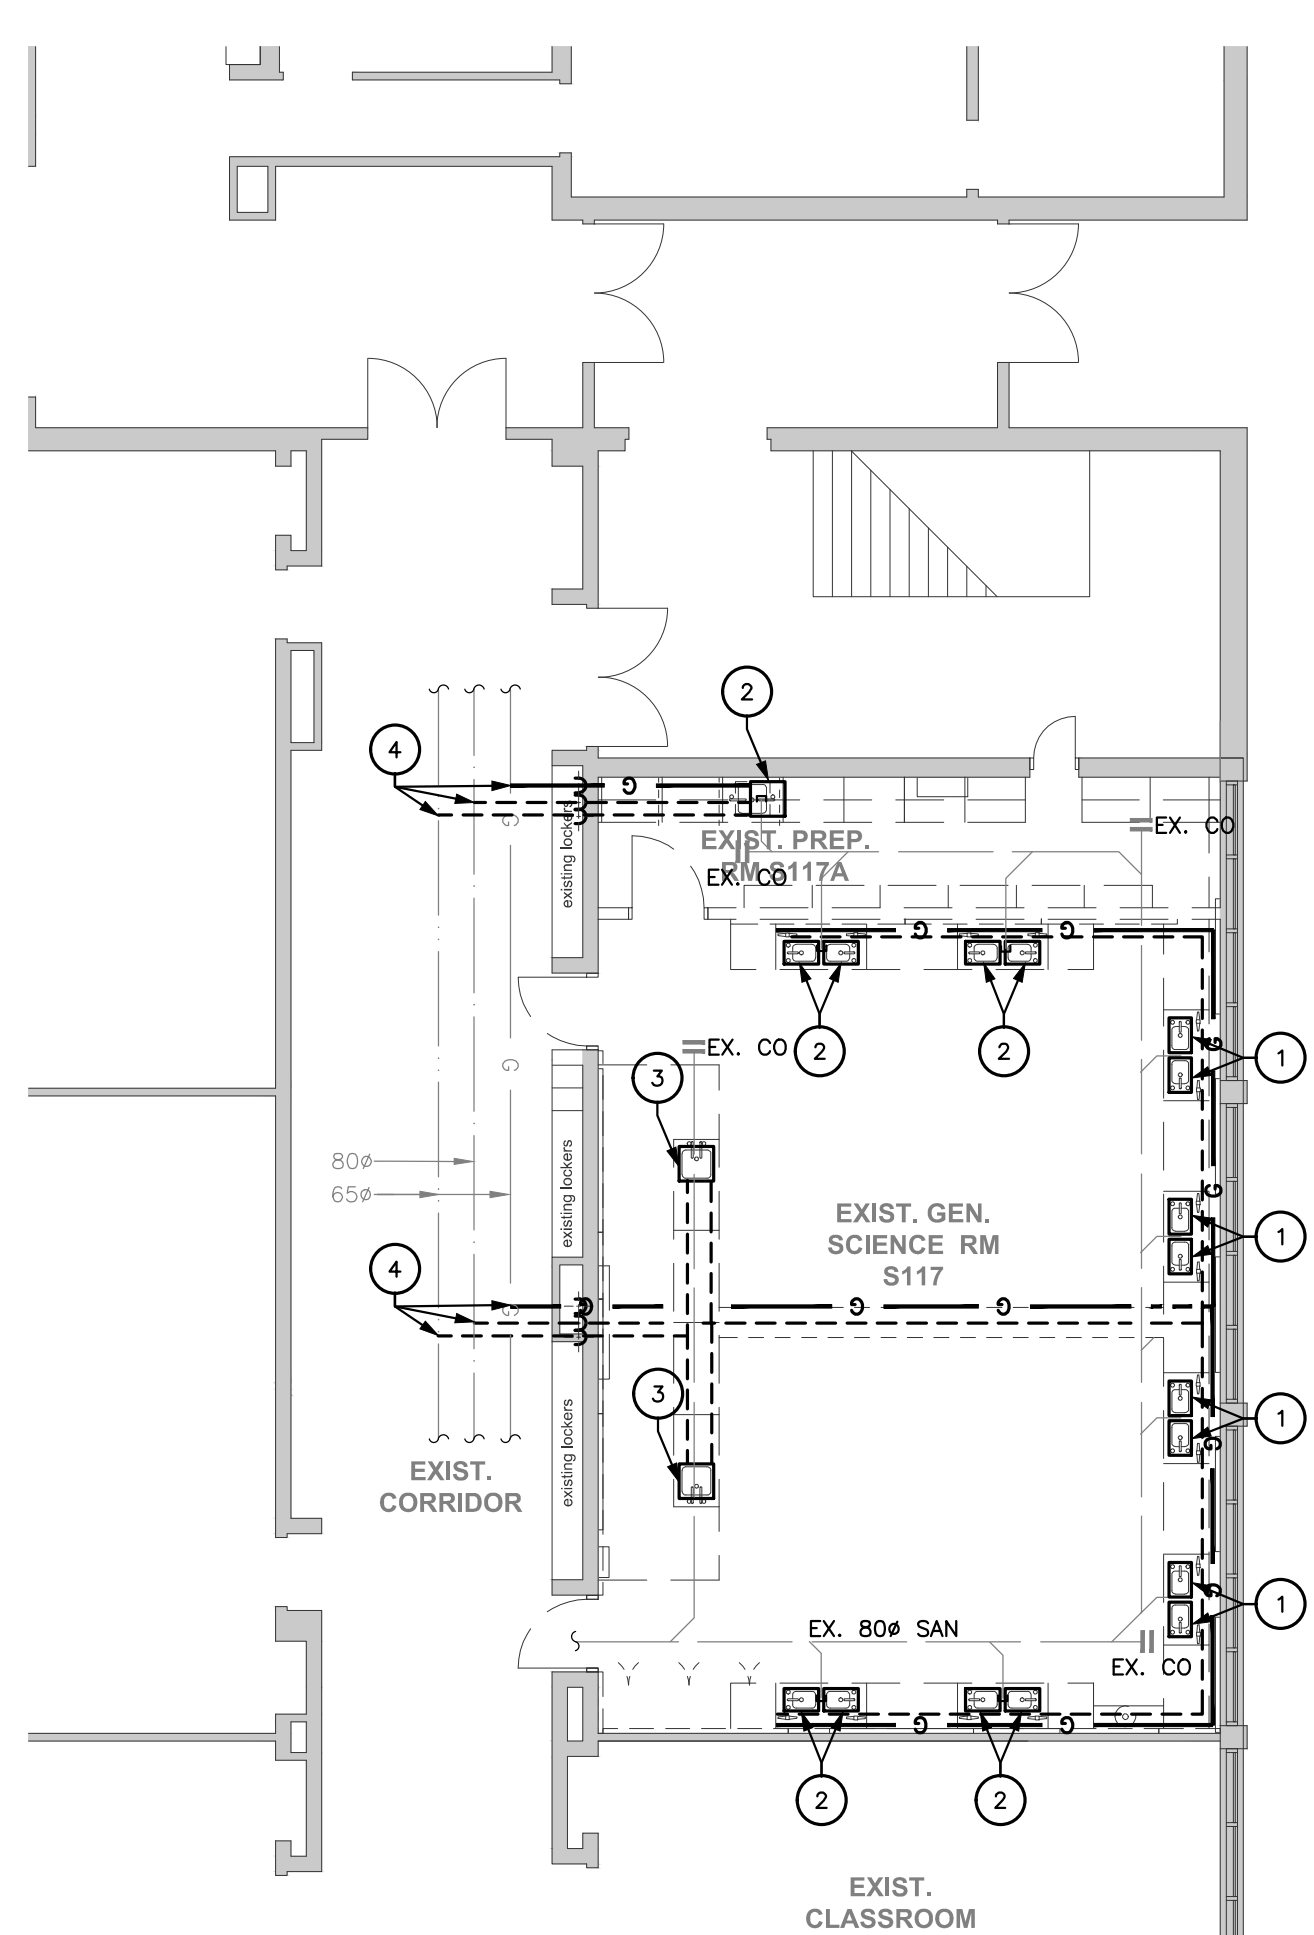

2 AREA 2 - DEMOLITION PLUMBING & DRAINAGE  
M100 1:100

**DRAWING NOTES**

1 -


**DRAWING NOTES**

- EXISTING PLUMBING FIXTURE SHALL BE REMOVED & DISPOSED OF. DEMOLISH ASSOCIATED PLUMBING, VENT, & DRAINAGE PIPING.
- EXISTING GAS TURRET SHALL BE REMOVED & DISPOSED OF. ASSOCIATED GAS PIPING WITHIN MILLWORK SHALL BE DEMOLISHED.
- EXISTING PIPING WITHIN TRENCH (GAS & DOMESTIC WATER) SERVING MILLWORK SHALL BE REMOVED & DISPOSED OF.
- EXISTING PIPE DROPS SERVING INSTRUCTOR STATION, ALL PIPE RUNS FROM PIPE DROPS TO/FROM INSTRUCTOR STATION MILLWORK AND ASSOCIATED VALVES/CONTROL DEVICES SHALL BE REMOVED & DISPOSED OF.
- EXISTING SINK SHALL BE REMOVED & DISPOSED OF. DEMOLISH ASSOCIATED DOMESTIC WATER PIPING, ASSOCIATED SANITARY PIPING SHALL BE DEMOLISHED TO BELOW-FLOOR LEVEL AND CAPPED.
- EXISTING VENT PIPING WITHIN WALL SERVING EXISTING SINK AND DRINKING FOUNTAIN SHALL BE DEMOLISHED AS REQUIRED TO ALLOW DEMOLITION OF WALL. PROVIDE NEW VENT PIPING FOR EXISTING DRINKING FOUNTAIN AS REQUIRED AND CONNECT TO NEAREST VENT PIPING.
- REMOVE AND DISPOSE OF EXISTING UNDERCOUNTER CHEMICAL DISPENSER AND WATER SOFTENER. REMOVE AND DISPOSE OF ALL ASSOCIATED PIPING.
- REMOVE AND DISPOSE OF EXISTING FLOOR CLEANOUT. CUT PIPING BACK TO BELOW-FLOOR LEVEL & CAP.
- EXISTING FIRE EXTINGUISHER & MOUNT SHALL BE REMOVED & DISPOSED OF.
- EXISTING THERMOSTATIC MIXING VALVE & TEMPERED LINE SERVING EYEWASH SHALL BE REMOVED & DISPOSED OF.

**DRAWING NOTES**

- EXISTING SINK SHALL BE REMOVED AND DISPOSED OF. DEMOLISH ASSOCIATED PLUMBING PIPING. SANITARY CONNECTION TO BE CUT BACK TO A STUB TO BE RE-USED FOR NEW SINK. DEMOLISH ADJACENT COUNTER-MOUNTED GAS TURRETS AND ALL ASSOCIATED GAS PIPING AS INDICATED.
- EXISTING SINK SHALL BE REMOVED AND DISPOSED OF. DEMOLISH ASSOCIATED PLUMBING PIPING. SANITARY CONNECTION SHALL BE DEMOLISHED TO HORIZONTAL SECTION BELOW FLOOR LEVEL AND CAPPED. DEMOLISH ADJACENT COUNTER-MOUNTED GAS TURRETS AND ALL ASSOCIATED GAS PIPING AS INDICATED.
- EXISTING SINK SHALL BE REMOVED AND DISPOSED OF. DEMOLISH ASSOCIATED PLUMBING PIPING. SANITARY CONNECTION SHALL BE DEMOLISHED TO HORIZONTAL SECTION BELOW FLOOR LEVEL AND CAPPED.
- DEMOLISH PIPING BACK TO MAINS IN HALLWAY AND CAP AT EXISTING TEE. CONTRACTOR SHALL ALLOW FOR PIPE FREEZING FOR DOMESTIC WATER PIPES.

1 AREA 1 - DEMOLITION PLUMBING & DRAINAGE  
M100 1:100

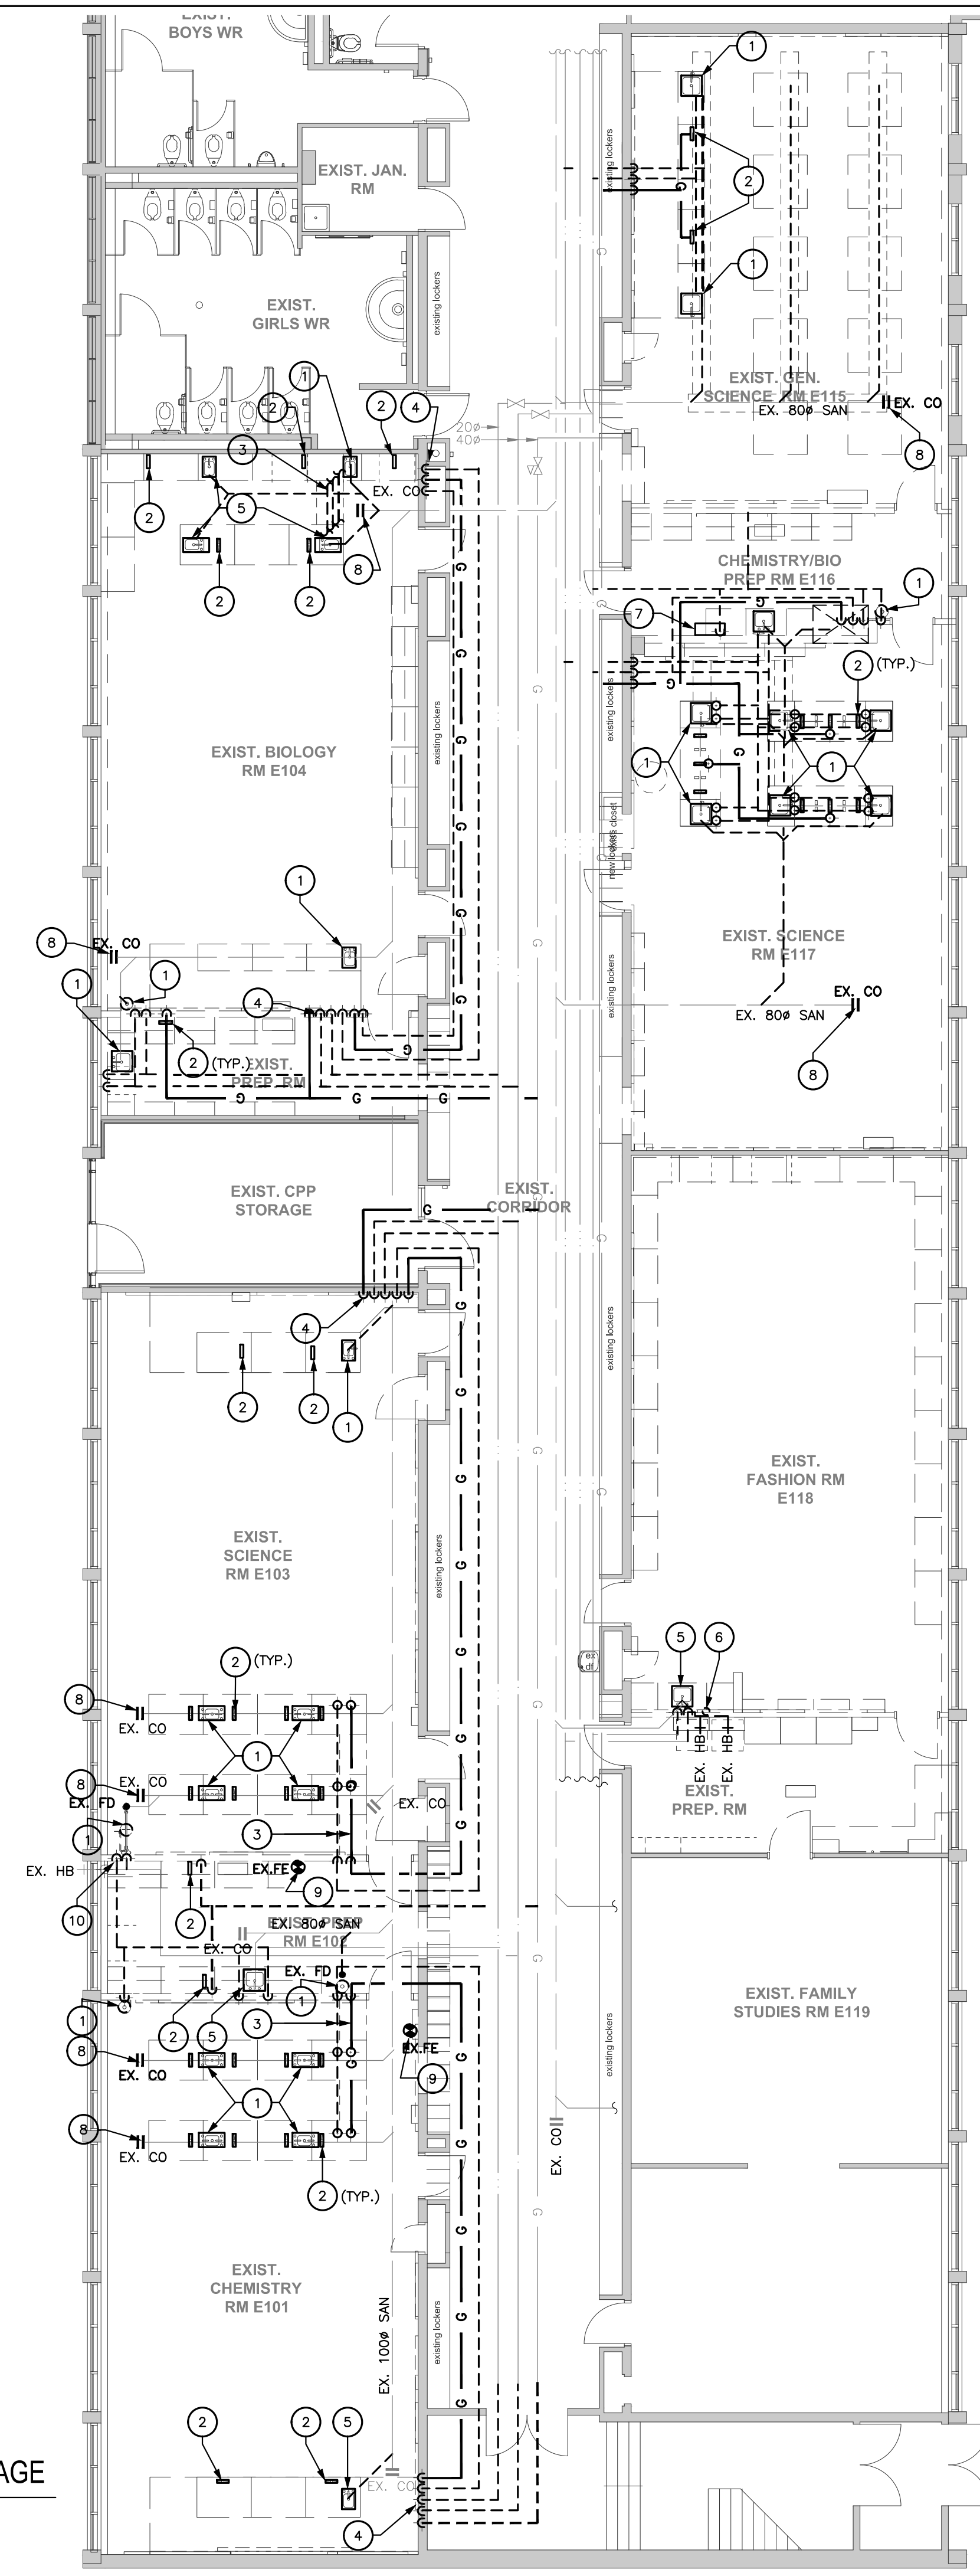

Key Plan N.T.S.



Project North True North

No.	Revisions	Date
3.	Issued for Bids	2024 04 09
2.	Issued for Permit	2024 03 21
1.	Issued for Progress	2024 03 12
No.	Issue	Date

General Contractor shall check and verify all dimensions and report all errors and omissions to the Architect. Do not scale the drawings. Drawings shall not be used for construction purposes until issued by the Architect for construction.

Drawing Title:  
**DEMOLITION PLUMBING & DRAINAGE PLAN**

Scale: AS NOTED Date: 02/01/2024

Drawn by: C.M. Checked by: W.D.

Job No. Drawing No.

**2215B M100**



Key Plan N.T.S.



Project North True North

No.	Revisions	Date
3.	Issued for Bids	2024 04 09
2.	Issued for Permit	2024 03 21
1.	Issued for Progress	2024 03 12
No.	Issue	Date

General Contractor shall check and verify all dimensions and report all errors and omissions to the Architect. Do not scale the drawings. Drawings shall not be used for construction purposes until issued by the Architect for construction.

Drawing Title:  
**PROPOSED PLUMBING  
 & DRAINAGE PLAN**

Scale: AS NOTED Date: 02/01/2024

Drawn by: C.M. Checked by: W.D.

Job No. Drawing No.

2215B

M101

### DRAWING NOTES

- 1 ABOVE GROUND SANITARY PIPING FROM PLUMBING FIXTURES SHALL BE CONCEALED WITHIN ARCHITECTURAL KNEE WALL AND MILLWORK. CONNECT TO SURFACE-MOUNTED ACID NEUTRALIZING TANK, THEN DROP TO BURIED AS INDICATED. ALL PIPING UPSTREAM OF NEUTRALIZATION TANK SHALL BE ACID RESISTANT PVC, REFER TO SPECIFICATIONS.
- 2 DROP CONCEALED GAS, DCW, & DHW PIPING DOWN TO ARCHITECTURAL KNEE WALL AND DISTRIBUTE TO ALL PLUMBING FIXTURES & GAS TURRETS. REFER TO MECHANICAL DETAILS.
- 3 LOCATION OF NATURAL GAS SHUTOFF BUTTON. INSTALL IN GENERAL CONTRACTOR SUPPLIED AND INSTALLED MILLWORK/MODULAR CONTROL PANEL. REFER TO ELECTRICAL DRAWING E301 AND COORDINATE EXACT LOCATION WITH GENERAL CONTRACTOR
- 4 LOCATION OF FUME HOOD DRAIN, INSTALL PIPING ABOVE GRADE IN FUME HOOD CABINET C/W ACID RESISTANT P-TRAP. PENETRATE THROUGH FUME HOOD SIDEWALL TO MILLWORK AND CONNECT TO PIPING UPSTREAM OF ACID NEUTRALIZATION TANK.
- 5 CONNECT 15Ø DCW AND GAS TO NEW FUME HOOD (SUPPLIED & INSTALLED BY GENERAL DIVISION) AS PER MANUFACTURER'S INSTRUCTIONS. PIPING SHALL BE CONCEALED.
- 6 DROP 15Ø DCW & DHW PIPING CONCEALED WITHIN WALL, CONNECT TO SINK IN PREP ROOM E102 CONCEALED WITHIN MILLWORK.
- 7 NEW FUNNEL FLOOR DRAIN TO BE INSTALLED CONCEALED IN MILLWORK C/W TRAP SEAL PRIMER, PROVIDE SLOPED 25Ø GRAVITY CONDENSATE PIPING FROM EACH UNIT VENTILATOR IN THE SAME ROOM TO TERMINATE AT DRAIN WITH 25mm AIR GAP. CONDENSATE PIPE DROPS SHALL BE CONCEALED IN WALL OR WITH CUSTOM STEEL PIPE CHASE PAINTED TO MATCH WALL. REFER TO HVAC DRAWINGS FOR HUV LOCATIONS.

### DRAWING NOTES

- 1 CONNECT TO EXISTING MAINS IN CORRIDOR. VERIFY EXACT LOCATIONS ON SITE.
- 2 DROP ABOVE GROUND SANITARY SERVING NEW SINK TO BURIED IN INDICATED LOCATION AND CONNECT TO EXISTING BURIED SANITARY LINE C/W STACK CLEANOUT. LOCATE EXACT EXISTING SANITARY LINE LOCATION BEFORE EXECUTING THIS WORK. REPORT TO ENGINEER OF ANY CONCERNS. NEW SINK SHALL BE VENTED TO NEAREST EX. PLUMBING VENT ON THIS FLOOR.

3  
M101 1:100

4  
M101 1:100

### DRAWING NOTES

- 1 DROP CONCEALED GAS, DCW, & DHW PIPING DOWN TO ARCHITECTURAL KNEE WALL AND DISTRIBUTE TO ALL PLUMBING FIXTURES & GAS TURRETS. REFER TO MECHANICAL DETAILS.
- 2 LOCATION OF NATURAL GAS SHUTOFF BUTTON TO BE INSTALLED WITHIN MODULAR CONTROL PANEL (SEE ELECTRICAL DRAWINGS). WIRE TO NORMALLY OPEN SOLENOID VALVE IN CORRIDOR. REFER TO MECHANICAL SPECIFICATIONS.

3  
M101 1:100

### DRAWING NOTES

- 1 DROP CONCEALED GAS, DCW, & DHW PIPING DOWN TO ARCHITECTURAL KNEE WALL AND DISTRIBUTE TO ALL PLUMBING FIXTURES & GAS TURRETS. REFER TO MECHANICAL DETAILS.
- 2 LOCATION OF NATURAL GAS SHUTOFF BUTTON TO BE INSTALLED WITHIN MODULAR CONTROL PANEL (SEE ELECTRICAL DRAWINGS). WIRE TO NORMALLY OPEN SOLENOID VALVE IN CORRIDOR. REFER TO MECHANICAL SPECIFICATIONS.

2  
M101 1:100

### DRAWING NOTES

- 1 DROP CONCEALED GAS, DCW, & DHW PIPING DOWN TO ARCHITECTURAL KNEE WALL AND DISTRIBUTE TO ALL PLUMBING FIXTURES & GAS TURRETS. REFER TO MECHANICAL DETAILS.
- 2 LOCATION OF NATURAL GAS SHUTOFF BUTTON TO BE INSTALLED WITHIN MODULAR CONTROL PANEL (SEE ELECTRICAL DRAWINGS). WIRE TO NORMALLY OPEN SOLENOID VALVE IN CORRIDOR. REFER TO MECHANICAL SPECIFICATIONS.

1  
M101 1:100













